

sweet swiss energy research
for the energy transition



PATHFNR

PATHFNR Workshop 2022

Posters



ETH zürich



Empa

PAUL SCHERRER INSTITUT
PSI

zhaw

**HOCHSCHULE
LUZERN**



**UNIVERSITÉ
DE GENÈVE**

EPFL



TU Delft

PATHFNDR WORKSHOP

List of posters

Version 12.09.2022

#	Last name	First name	Institution	PI	Title	Topic
1	Marcucci	Adriana	ETH Zurich	Schaffner	SWEET CROSS	Overall
2	Ruefenacht	Lea	ETH Zurich	Bardow / Schaffner	PATHFNDR project overview	Overall
3	Marcucci	Adriana	ETH Zurich	Pfenninger	PATHFNDR scenarios	National scenarios
4	Vulic	Natasa	Empa	Rüdisüli	Flexibility potentials across Europe	National scenarios
5	Schwarz	Marius	ETH Zurich	Schaffner	How dependent is the Swiss energy transition on developments abroad?	National scenarios
6	Schlecht	Ingmar	ZHAW	Schlecht	Storage reserve for Switzerland. Is it necessary and (how) could it work?	National scenarios
7	Baader	Florian	ETH Zurich	Bardow	Integrating scheduling of multi-energy systems and industrial processes	National scenarios
8	Ludger	Leenders	ETH Zurich	Bardow	Integration of detailed electricity grid and sector-coupled energy system models: Nexus-e engages with SecMOD	National scenarios
9	Sanvito	Francesco	TU Delft	Pfenninger	Euro-Calliope and integration of smart charging mechanisms into Calliope framework	National scenarios
10	Wang	Zongfei	UNIGE	Trutnevyte	Electric vehicles in a spatial-explicit EXPANSE electricity system model	National scenarios
11	Patricia	Mayer	ETH Zurich	Bardow	Transition paths towards a CO2-Based chemical industry within a sector-coupled energy system	National scenarios
12	Christof	Knoeri	ETH Zurich	Hoffmann	Cyber-physical platforms: conceptual foundations and empirical case study	National scenarios
13	Christof	Knoeri	ETH Zurich	Hoffmann	Cross-sectoral collaboration for a green hydrogen value chain	Hydrogen
14	Ganter	Alissa	ETH Zurich	Sansavini	Optimal design of hydrogen supply chains to decarbonize hard-to-abate industrial sectors in Europe	Hydrogen
15	Peter	Christian	PSI	Peter	PSI's Energy System Integration Platform (ESI)	Hydrogen
16	Peter	Christian	PSI	Peter	Model development for advanced control algorithms	Hydrogen
17	Evrenosoglu	Yaman	ETH Zurich	Marinakis / Demiray	Planning and operation of multi-energy systems	Flexibility and sector coupling
18	Massimo	Fiorentini	Empa	Fiorentini	Optimal integration of Borehole Thermal Storage in district heating and cooling networks	Flexibility and sector coupling
19	Lucas	Edward	HSLU		Model development of integrated systems	Flexibility and sector coupling
20	Linder	Esther	HSLU	Schütz / Villasmil	Estimating heat demand of residential buildings	Flexibility and sector coupling
21	Koirala	Binod	Empa	Koirala	Flexibility assessment of e-mobility in multi-energy districts	Flexibility and sector coupling
22	Gupta	Rahul	EPFL	Paolone	Modelling and control of multi-energy systems in a microgrid	Flexibility and sector coupling
23	Gupta	Rahul	EPFL	Paolone	Coordinated multi-grid dispatch framework	Flexibility and sector coupling
24	Winzer	Christian	ZHAW	Winzer	Network tariffs for flexible loads	Flexibility and sector coupling

The PATHFNDR consortium

Pathways to an efficient future energy system through flexibility and sector coupling (2021-2027)

In line with the national vision of net-zero GHG emissions PATHFNDR imagines an **efficient, flexible, resilient, cost-effective, and sustainable Swiss energy system by 2050.**

Within this future, the main goal of PATHFNDR is to develop and analyze **energy transition pathways for renewable energy integration in Switzerland.**

Main objectives

1 Improve performance

Identify synergies and tradeoffs between efficiency, resilience, sustainability and cost-competitiveness of energy systems

2 Foster sector coupling

Evaluate technologies, business models, innovation strategies, policies and end-user acceptance for sector coupling

3 Enable flexibility

Assess system flexibility options across various sectors and along various spatiotemporal scales

Expected outcomes

Feasible pathways

for enabling renewable energy integration

Planning & operation tools

for assessing pathways and technologies

Business opportunities & innovation strategies

at value chain and firm levels

Potential policies

for the energy transition

Pilot & demonstration (P&D) projects

for testing market designs and technologies

WP 1

Quantification of large-scale **energy pathways for Switzerland** (embedded in its European context)

WP 2

Assessment of energy pathways at **local-scale uses cases** (cities, villages, districts, site, networks)

WP 3

Analysis of **technologies** from multiple **energy sectors** (thermal, electrical and gas)

WP 4 & 5 (P&D)

Implementation of **pilot & demonstration projects** to test market designs and technologies

WP 6

Identification of **disruptions and business interests** as well as strategies to address them

WP 7

Analysis of political feasibility, **public acceptance**, and effects of **policies in Switzerland**

WP 8 & 9

Management of project activities and results, and **KTT** to the various stakeholders

WP 10

Coordination of **scenarios** as well as **integration and synthesis** of research results



CONSORTIUM

ETH zürich Empa

Lucerne University of Applied Sciences and Arts

HOCHSCHULE LUZERN

PAUL SCHERRER INSTITUT PSI

zhaw

+ industry partners

UNIVERSITÉ DE GENÈVE

EPFL

TU Delft

CONTACT

Lea A. Ruefenacht
ETH Zurich
Energy Science Center
lea.ruefenacht@esc.ethz.ch
www.sweet-pathfndr.ch



ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.


SWEET-CROSS

CooRdination Of Scenarios and Data in SWEET

What is CROSS?

CROSS is an activity of the Swiss Federal Office of Energy's "SWEET" programme that aims at:

- **increasing comparability** of the simulations and
- **increasing credibility** of the results from the simulations from the SWEET consortia DeCarbCH, EDGE, PATHFNDR and SURE

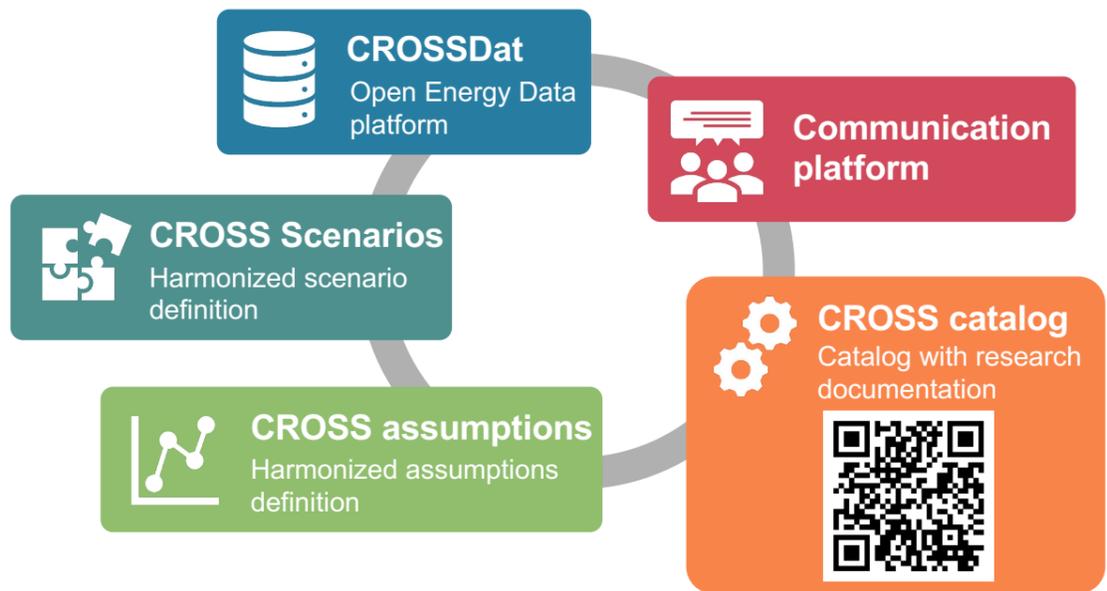

CROSSDat


Platform with unified access to SWEET and energy related (research) data, **irrespective of where it is stored and curated.**



Features


1. It is both a metabase and a database
2. CROSSDat uses Frictionless standards for data packages and metadata
3. CROSSDat principles: Unified data access, Distributed research data management, Findable, Accessible, Interoperable, Reusable

Structure

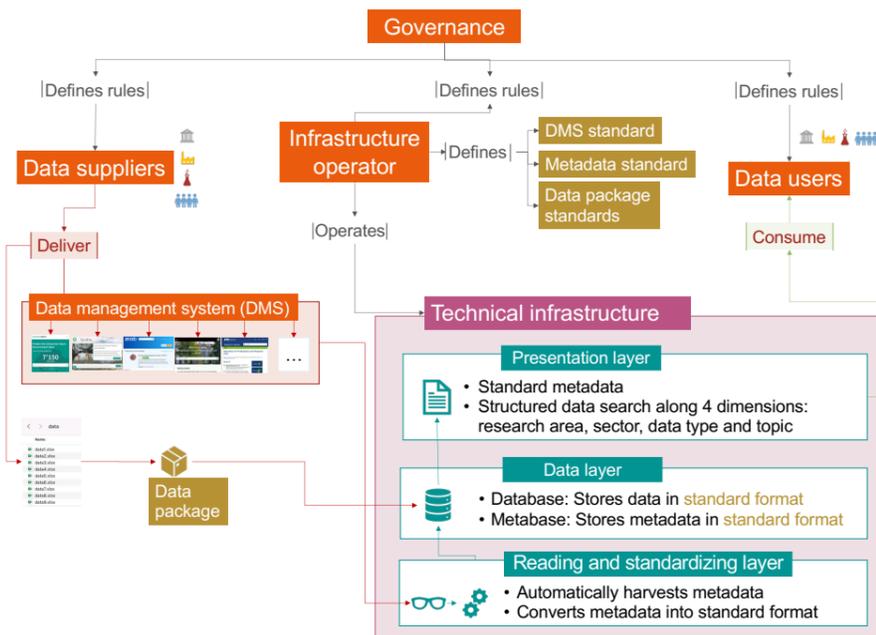


CROSS Scenarios

- Scenarios are **alternative developments** of the future energy system
- CROSS scenarios are defined along two dimensions: Climate policy and energy market integration

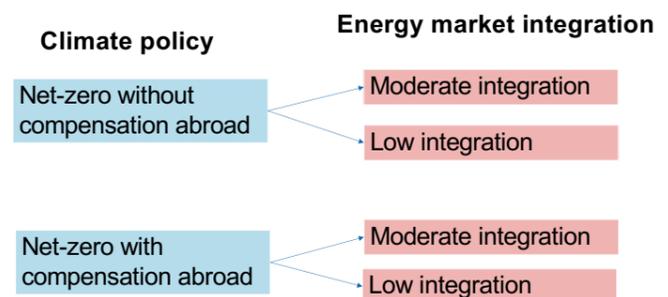

CROSS assumptions

Harmonization of uncertain drivers, including, socioeconomic development, demands, global climate change and resources

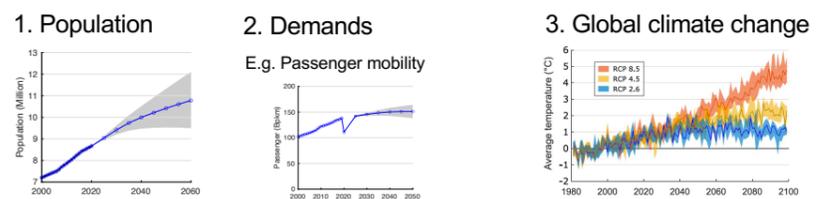

4. Resources

	Renewable potentials (TWh/a)		
	Hydropower	Solar	Wind
Low	34.8	30	1.7
Reference	36.4	45	4.3
High	38.4	88	15

PATHFNR scenarios

Work package 1

Adriana Marcucci¹, Mahendranath Ramakrishnan², Francesco Sanvito², Stefan Pfenninger²

¹ Energy Science Center, ETH Zurich, Zurich, Switzerland


² Faculty of Technology, Policy and Management (TPM), Delft University of Technology, Delft, the Netherlands

What are PATHFNR scenarios?

- Scenarios are **alternative developments** of the future energy system
- Quantifying these scenarios helps us with understanding the role of **flexibility** and **sector coupling** in achieving the Swiss net zero GHG goal

Scenario dimensions

- PATHFNR scenarios are defined along 3 dimensions on which Swiss citizens and policymakers **can** exert direct influence

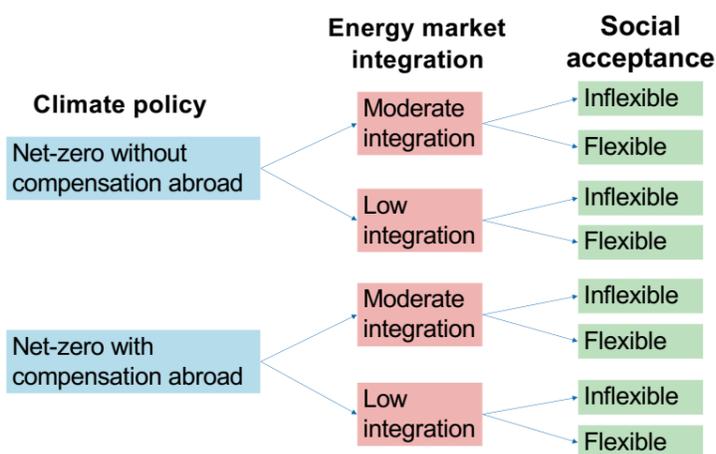


Climate policy dimension: Net zero GHG target

GHG emissions difficult to avoid



Carbon removal and avoidance



Carbon removal requirement is 4.8 MtCO₂, which can be compensated by the energy sector and abroad

	Energy emissions (MtCO ₂)	Carbon removal abroad (MtCO ₂)
Net-zero without compensation abroad	-4.8	0
Net zero with compensation abroad	-2.4	-2.4


Energy market integration dimension

Degree of self-sufficiency for different commodities

	Electricity	Biofuels and biomass	Hydrogen
Low integration	30% net transfer capacity	No imports	No imports
Moderate integration	100% net transfer capacity	56 PJ by 2050 from EP2050+ [1]	Upper limit from EP2050+ [1]

Uncertain drivers

- Uncertainties: Affect the energy system directly or indirectly

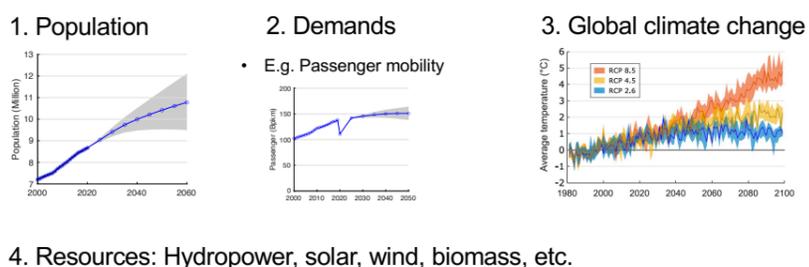

Social acceptance dimension

- Public acceptance of new infrastructure
- Willingness to change consumption patterns

	Renewable potentials (TWh/a)		
	Hydro-power	Solar	Wind
Inflexible	34.8	30	1.7
Flexible	38.4	88.2	15

	Time by which use can be shifted	
	Appliances	Vehicle charging
Inflexible	0	0
Flexible	24 hours	72 hours

PATHFNR Scenarios – Europe

- Import of fuels from outside Europe
- Import of electricity from outside Europe
- CO₂ compensation abroad (within Europe)
- Interconnections between European countries
- Continent-scale hydrogen transport
- Actions of neighbouring countries of Switzerland

Scenarios' descriptions

- a) No fuel imports allowed.
- b) Fuel imports are allowed but available starting from 2035 [2].
- c) Fuel imports are allowed but available starting from 2045 [2].
- a) No electricity imports allowed outside Europe.
- b) Electricity imports are allowed but available starting from 2035.
- c) Electricity imports are allowed but available starting from 2045.
- a) Allowed to sequester emissions abroad within Europe.
- b) Net-zero emissions carbon budgets are imposed on each country.
- a) Restrict the transmission networks according to development plans' levels at different points in time (now, 2030, 2045, etc.) [3].
- b) No transmission constraints.
- a) Restrict the availability of hydrogen transport to European Hydrogen Backbone's projections [4].
- b) No hydrogen transport capacity constraints.
- a) No asymmetry in European countries' behaviours.
- b) Germany divergent. E.g.: Germany depends on massive hydrogen imports from outside Europe.
- c) France goes rogue: France, for example, could go for a nuclear renaissance.

What are the impacts of European policies on Switzerland energy system planning?



Additional sensitivity analyses and scanning of alternative configurations with different flexibility options will be performed.

REFERENCES

- [1] BFE, 2020. Energieperspektiven 2050+.
- [2] van der Zwaan et al. 2021.
- [3] EC, REPowerEU, Fit for 55, Electricity interconnection targets
- [4] EHB. 2022, European Hydrogen Backbone report

CONTACT

Adriana Marcucci, ETH Zurich, adriana.marcucci@esc.ethz.ch
 Mahendranath Ramakrishnan, TU Delft, M.Ramakrishnan@tudelft.nl
 Francesco Sanvito, TU Delft, F.Sanvito@tudelft.nl
 Stefan Pfenninger, TU Delft, S.Pfenninger@tudelft.nl

www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

Flexibility potentials across Europe

WORK PACKAGE 1 (Task 2)

Natasa Vulic¹, Martin Rüdüsüli¹

¹Urban Energy Systems Laboratory, Swiss Federal Laboratories for Materials Science and Technology, Empa, Dübendorf, Switzerland

1 OBJECTIVES

The use of flexibility in terms of seasonal energy storage and demand shifting will play a vital role in the future European energy system that mainly relies on intermitted and stochastic renewable generation from solar and wind.

The flexibility options include power-to-X (hydrogen, methane, heat, etc) and demand side management (DSM). While DMS mainly relies on the share of energy demands that can be shifted within short-terms (hours to days), power-to-X needs seasonal storage capacities such as salt caverns, etc. for gaseous energy carriers such as methane or hydrogen. Moreover, for renewable carbon-based energy carrier (i.e., methane) nearby CO₂ sources are required for economically viable operation.

2 CONTRIBUTION TO PATHFNR


The flexibility options found here are used as inputs in the Euro-Calliope model for the modelling of scenarios at the European scale.

Due to the high spatial (NUTS-3) and temporal (hourly) resolution of the Euro-Calliope model, all parameters of these flexibility options need to be at this spatial and temporal granularly, too.

Results from the modelling at the European scale will then be used as inputs for NEXUS-E to model the Swiss energy system in detail.


2 METHODOLOGY

- Existing data flexibility options at the European Scale from past projects (e.g. CO₂StoP, etc.) are gathered
- The gathered data is assessed with respect to its applicability as inputs for the Euro-Calliope model
- With GIS this data is aggregated and converted to the required spatial and temporal granularity of the Euro-Calliope model
- Results from Euro-Calliope model runs are used as feedbacks to improve the quality of input data for successive runs


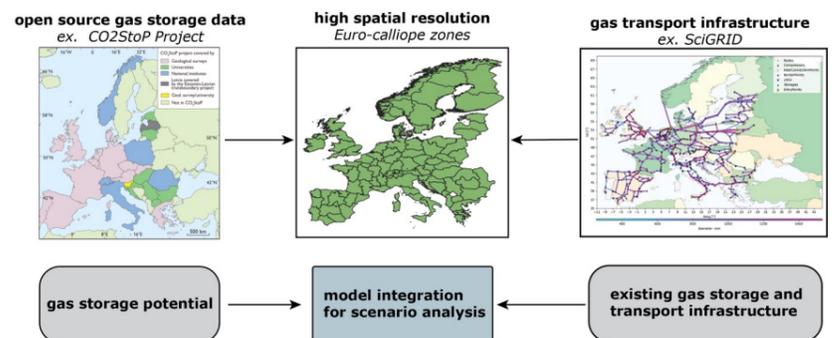


3 RESULTS

Hydrogen storage potential

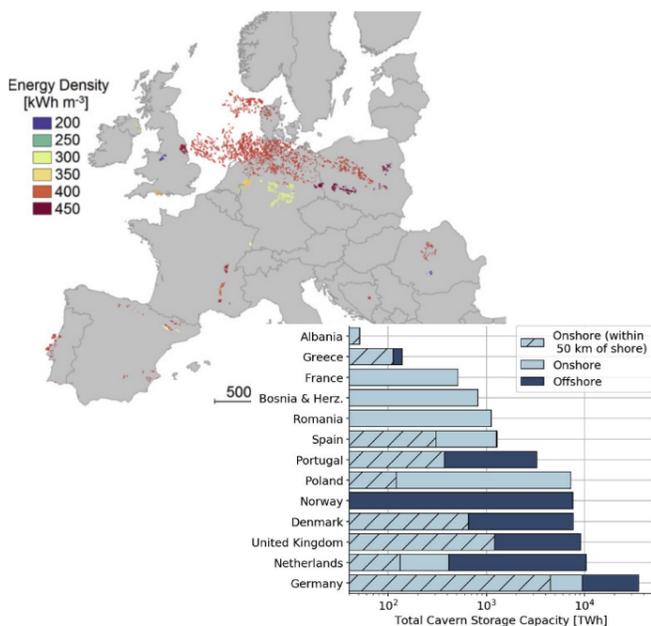

CO₂ storage potential

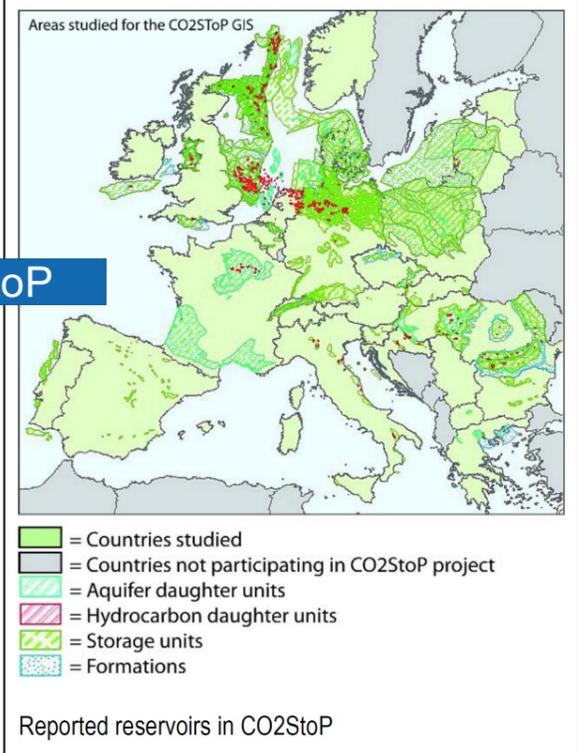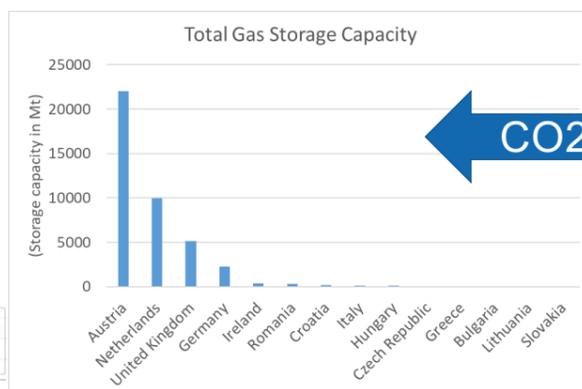

REFERENCES

- Poulsen, N.E., Bocin-Dumitriu, A., Holloway, S., Kirk, K., Neele, F. and Smith, N., 2015: Reserves and resources for CO₂ storage in Europe: the CO₂StoP project. Geological Survey of Denmark and Greenland Bulletin 33: 85-882.
- Caglayan, D. G., Weber, N., Heinrichs, H. U., Linßen, J., Robinius, M., Kukla, P. A., & Stolten, D. (2020). Technical potential of salt caverns for hydrogen storage in Europe. *International Journal of Hydrogen Energy*, 45(11).
- PyPSA-Eur-Sec: A Sector-Coupled Open Optimisation Model of the European Energy System. Hydrogen potential data.

CONTACT

Natasa Vulic
Empa
Urban Energy Systems
Phone: +41 058 765 61 11
natasa.vulic@empa.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

Work package 1

How dependent is the Swiss energy transition on developments abroad?

Marius Schwarz¹, Pranjai Jain¹, Arijit Upadhyay¹, Jared Garrison², Elena Raycheva^{1,3}, Blazhe Gjorgiev⁴, Turhan Demiray², Giovanni Sansavini⁴, Christian Schaffner¹, Gabriela Hug³

¹ESC, Energy Science Center, ETH Zurich;

²FEN, Research Center for Energy Networks, ETH Zurich

³PSL, Power Systems Laboratory, ETH Zurich

⁴RRE, Reliability and Risk Engineering, ETH Zurich

Nexus-e

1 Importance of electricity trading

The Russian invasion of Ukraine this February revealed how dependent Switzerland's security of energy supply is on developments abroad. To reduce such dependency, Switzerland aims at an extensive electrification of the economy while simultaneously increasing the domestic, renewable electricity generation [1]. However, electrification of heating and transport and the expansion of solar power are leading to a seasonal electricity demand and supply imbalance. Therefore, electricity trading with neighboring countries is becoming increasingly important.

Whether electricity imports will remain possible in the future depends on the development of electricity generation and demand in neighboring countries as well as the regulatory and political framework. Like Switzerland, the EU aims at climate neutrality by 2050 as part of the European Green Deal [2]. In response to the uncertainty of Russian gas deliveries, the EU outlined the REPowerEU [3] plan which includes higher share of renewables in the energy mix (from today 17.4% to 45% in 2030) and a solar strategy (to achieve 600GW by 2030). While there is no explicit expansion target, wind power is expected to exceed 1000 GW by 2030 [4].


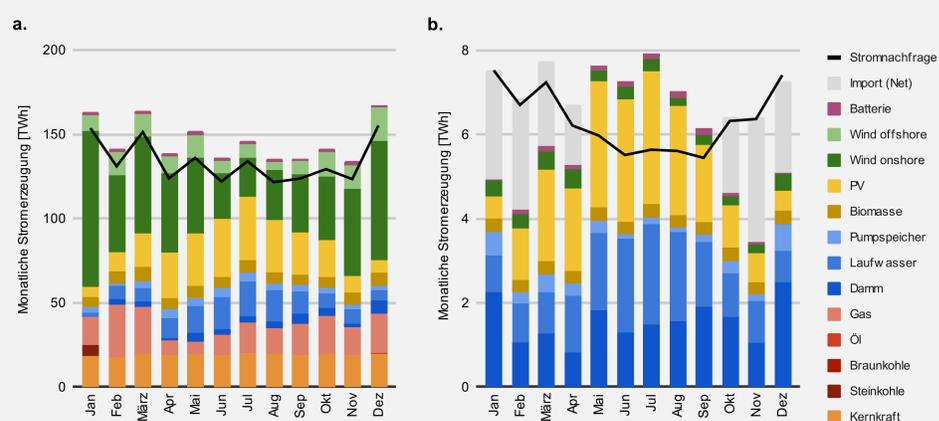


Figure: Monthly electricity generation in a. the neighboring countries and b. in Switzerland in 2050

At Energy Science Center of ETH Zurich, we use the Nexus-e platform to look at the impact of EU developments on Switzerland. In our scenarios, the 2050 Swiss electricity system, which is based on hydropower, PV, wind, biomass, and electricity trading, is sufficient to supply domestic demand. Electricity trading with neighboring countries is aided by the planned massive expansion of wind parks in Europe, which harmonizes seasonally with solar PV in Switzerland.

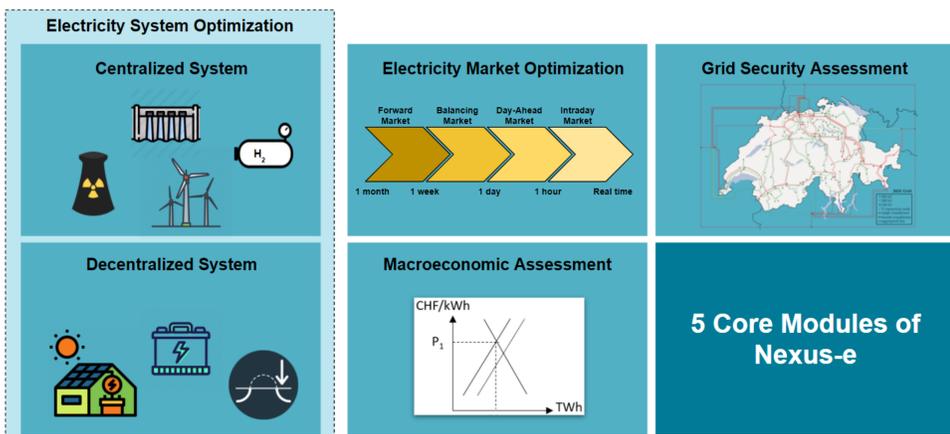

3 Gas as a transition fuel

Despite the current crisis, natural gas has just been added to the EU guidelines as "green" investments since July 2022 [6]. If neighboring countries rely heavily on gas as a transition fuel (with or without CCS), electricity prices (higher marginal costs) and overall system costs (as Swiss generation is driven out of the market) are increasing.

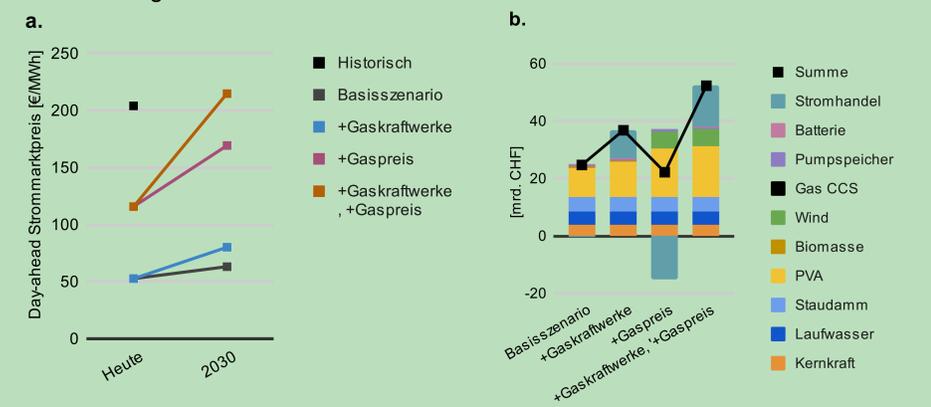


Figure: a. Electricity prices 2020 and 2030, b. Total system costs by 2030.

2 Gas prices affecting the Swiss electricity system

Gas prices have already been rising in Europe since last summer. Our scenarios outline four short-term effects of high gas prices on the Swiss electricity system:

- When increasing gas prices from €30/MWh (price before 2021) in the baseline scenario to €100/MWh (price at the beginning of 2022), electricity prices double in our scenarios. Compared to the historical day-ahead prices, we even underestimate the prices in the model (see Figure 3a.). One reason for this is that we do not consider the current downtime of French nuclear power plants and the drought that is affecting the hydro power generation
- With higher gas prices the utilization of other flexibility options such as pumped hydro increases as they replace expensive peak load gas units abroad.
- The overall costs of the Swiss electricity system are decreasing slightly, as domestic electricity producers can take advantage of high prices.
- In the neighboring countries, electricity generation from gas units is substituted by lignite and hard coal units, despite higher CO₂ costs.

The main long-term impact we observe is that more domestic generation capacity is installed as high electricity prices increase the profitability of these investments.

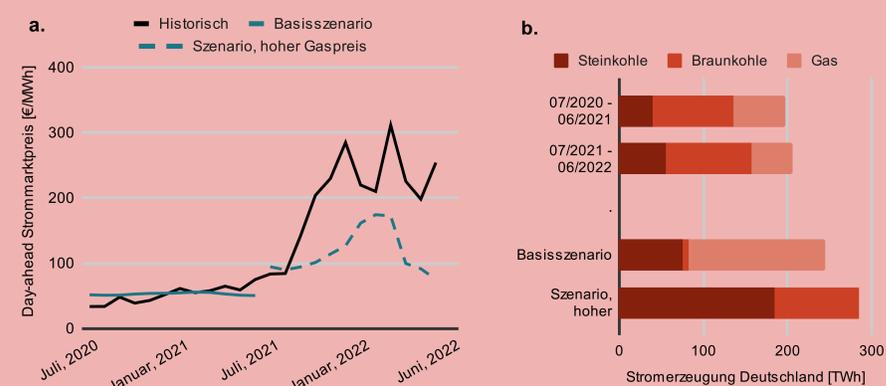


Figure: Impact of high gas prices on a. Electricity market prices and b. Electricity generation from fossil fuels in Germany [5]

REFERENCES

- [1] Energiestrategie 2050, Bundesamt für Energie
- [2] The European Green Deal, European Commission
- [3] REPowerEU Plan, European Commission, 2022
- [4] TYNDP scenarios, ENTSOE, 2022
- [5] Energy-charts.info
- [6] Complementary Delegated Act, European Commission

CONTACT

Dr. Marius Schwarz
ETH Zurich
Energy Science Center
Phone: +41 78 642 06 40
mschwarz@ethz.ch
www.sweet-pathfnr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.

Have a look at additional results and scenarios of this project directly in our webviewer!



Storage reserve for Switzerland

Is it necessary and (how) would it work?

Ingmar Schlecht, Jonas Savelsberg, Moritz Schillinger, and Hannes Weigt


ZHAW Winterthur / ETH Zurich / University of Basel

Background and objectives


A large part of Switzerland's generation capacity (>10 GW) is based on storage or pumped storage power plants, which can only produce when the reservoirs are not empty. In order to increase security of supply in winter, the SFOE has therefore proposed a storage reserve. This would pay storage operators to maintain a minimum water level in their reservoirs and thus leave part of the stored energy unused during normal operation in order to be prepared for critical situations.

In this research paper, we first present the theory of a storage reserve and explain the economic basis of storage reserve pricing. Second, we use Swissmod, a DC load-flow electricity market model for Switzerland with a high level of detail in hydropower, to model an electricity market with a storage reserve. We endogenously derive a competitive procurement of storage reserves at the lowest cost and then test the reserves in different shock scenarios where we specify autarkies with different lengths.

Mechanics of a storage reserve

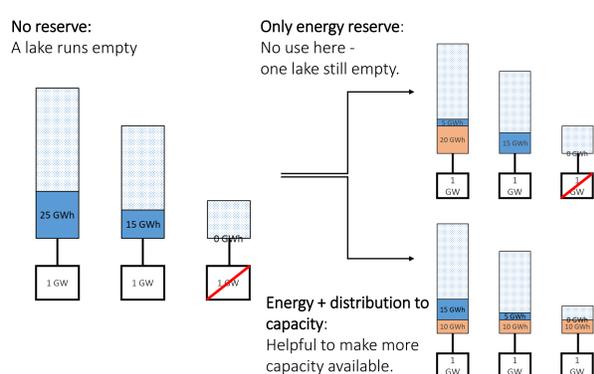

Economic costs of storage reserve reservation (in normal operation, without call-up costs)


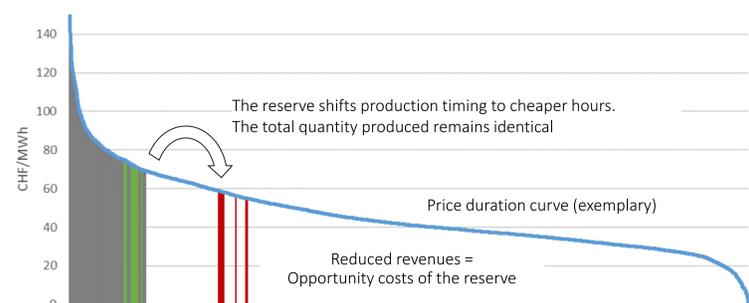


- Power plants with a large lake volume relative to turbine output have low opportunity costs of storage provision
- They would therefore submit the cheapest bids in a tender
- However, power plants with a smaller storage volume relative to turbine output are often decisive for security of supply.
- Only with a capacity requirement in the tender would these power plants (which are more expensive to reserve) also participate.

A storage reserve...

- ...reduces usable storage volume for normal operation
- ...therefore incurs costs in the form of lost revenues...
- ...but does not reduce the annual energy production (except in first year)



Results for short import crises (24h autarky)

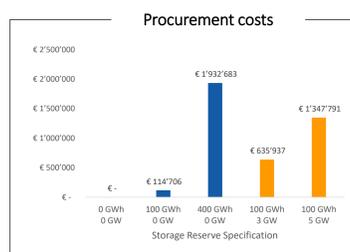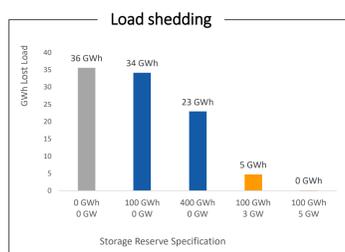

- Capacity (GW) is decisive to solve short import crises
- High energy levels reduce load shedding only slightly

- 100 GWh / 3 GW specification most efficient
- Overall manageable cost framework
- Assumption: perfect competition

Results for long import crises (1 week autarky)

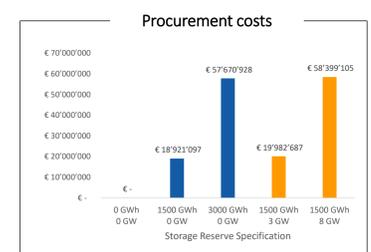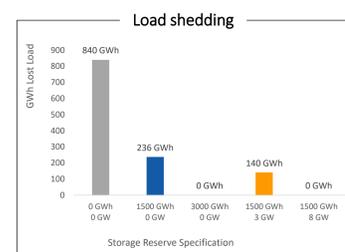

- Significant load shedding during 1 week import crisis (autarky)
- Capacity of the reserve less decisive for long autarkies

- High energy volumes cause significantly higher costs
- Assumption: perfect competition (but excessive bids to be expected at high capacity, then more expensive)

Conclusion

- **Distribution over sufficient capacity necessary.** Not only the specification of an energy quantity, but also the distribution over sufficient underlying power plant capacity is decisive for the effectiveness of a storage reserve. This applies in particular if short-term, strong shocks are also to be mitigated.
- **Cost-benefit difficult to assess.** The cost-benefit ratio of a storage reserve depends heavily on events at the political level (in connection with the allocation of cross-border capacities and Switzerland's participation in the European internal electricity market). It is therefore not possible to estimate it from a technical-economic point of view alone.
- **Market power problematic.** In particular if the storage reserve is designed with a capacity requirement, individual suppliers will be able to exercise market power (excessive prices). This should be taken into account when designing the procurement system.



Integrating Scheduling of Multi-Energy Systems and Industrial Processes

Work package 1: Pathways on a national and international scale

Florian Joseph Baader¹, Ludger Leenders¹, André Bardow¹

¹Energy and Process Systems Engineering, Department of Mechanical and Process Engineering, ETH Zurich

1 Harvesting flexibility by scheduling optimization



Idea: Coordinated scheduling provides flexibility through sector-coupling and allows to

- Minimize costs
- Stabilize the electricity grid


Challenge: Real-time scheduling of multi-energy systems and

- Batch process networks
- Dynamic Processes

$$\frac{dx}{dt} = f(x, u)$$

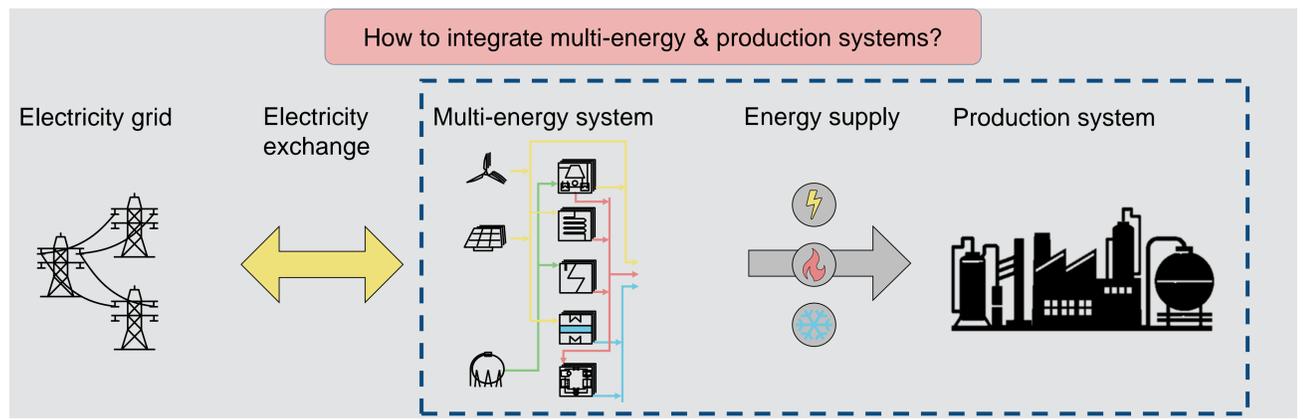


2 Relationship between systems defines optimization method [1]

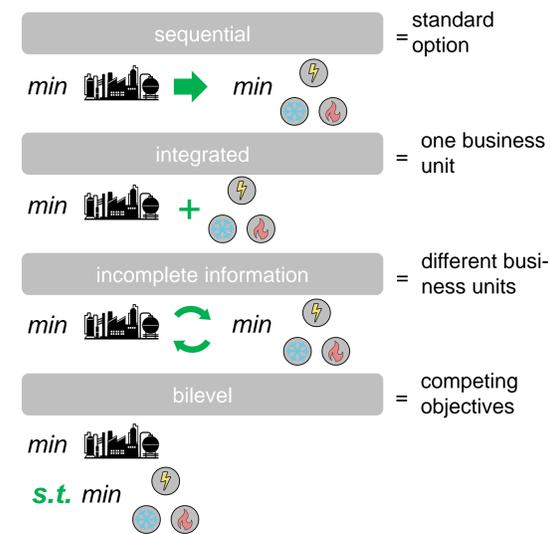


3 Optimization for misaligned objectives:

Coordination by incomplete information and bilevel optimization [2]

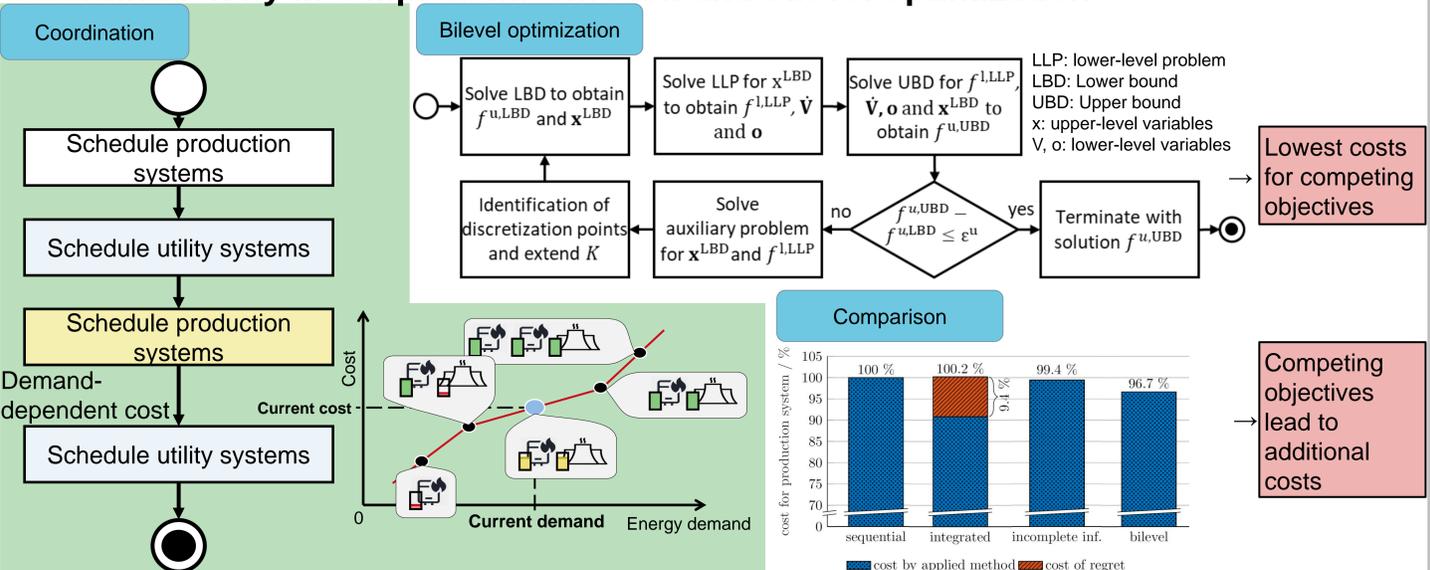

4 Integrated scheduling of dynamic processes and Energy systems [3]

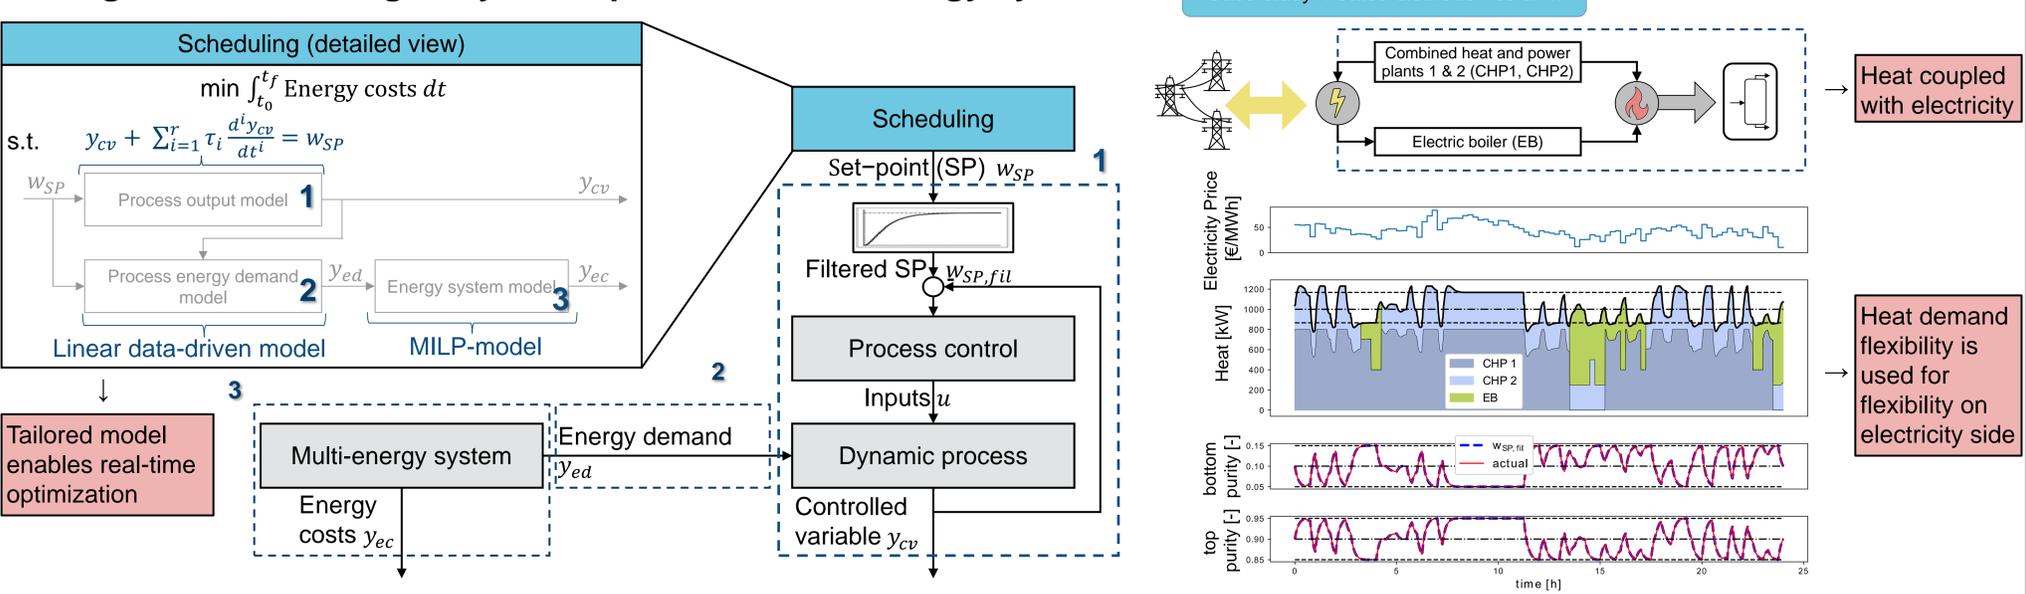

5 Conclusions

- Integrating multi-energy and production system scheduling results in large benefits
- Relationship between the system defines the optimization method
- Dynamic process increases challenge for integrated scheduling

6 Outlook

- Experimental validation
- Application to sector-coupled multi-energy systems within PATHFNR?

REFERENCES

- Leenders, L. (2022). Optimization Methods for Integrating Energy and Production Systems. PhD Thesis, Mainz Verlag.
- Leenders, L., Ganz, K., Bahl, B., Hennen, M., Baumgärtner, N., Bardow, A. (2021). Scheduling coordination of multiple production and utility systems in a multi-leader multi-follower Stackelberg game. Computers & Chemical Engineering, 150, 107321.
- Baader, F. J., Bardow, A., Dahmen, M. (2022). Simultaneous mixed-integer dynamic scheduling of processes and their energy systems. AIChE Journal, e17741

CONTACT

Florian Joseph Baader
 Energy & Process Systems Engineering
flbaader@ethz.ch
<https://epse.ethz.ch/>
 @EPSE_ETH



ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.



Integration of Detailed Electricity Grid and Sector-Coupled Energy System Models: Nexus-e Engages with SecMOD

Work package 1: Pathways on a national and international scale


Ludger Leenders¹, Jared Garrison², Florian Joseph Baader¹, Marius Schwarz³, André Bardow¹

¹Energy and Process Systems Engineering, Department of Mechanical and Process Engineering, ETH Zurich

²Research Center for Energy Networks, ETH Zurich

³Energy Science Center, ETH Zurich

Energy and Process System Engineering, Research Center for Energy Networks and Energy Science Center proudly announce the engagement of

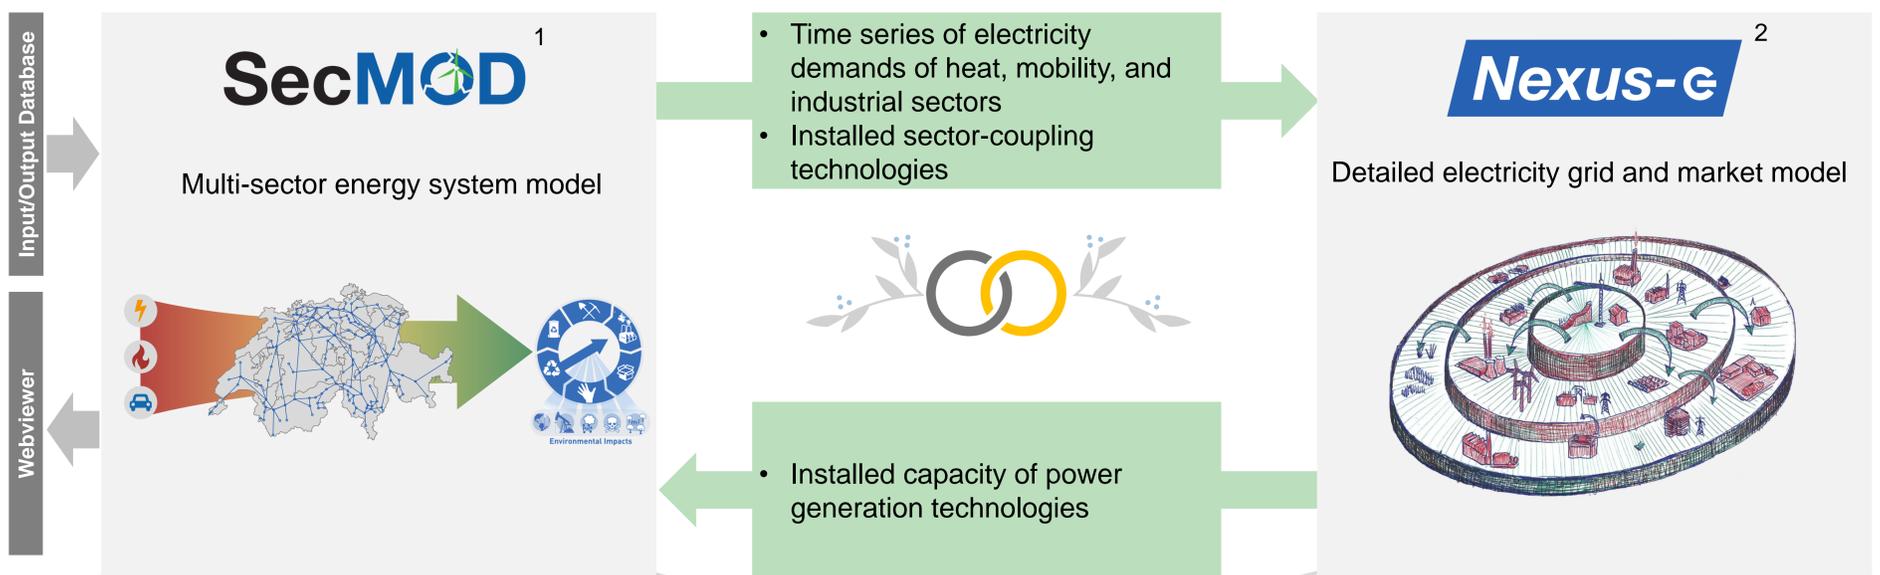

SecMOD¹

Multi-energy systems optimization

Life cycle assessment

- Framework for optimization & life cycle assessment of sector-coupled energy systems
- Multi-sector energy demands: electricity, residential, transport, industry
- Investment decisions & operation
- Holistic assessment of environmental impacts
- Open-source available
- Case study for Germany, Switzerland, EU steel plant, etc.

Nexus-e²

- High-resolution models for energy-economic assessments of future electricity systems
- Interdisciplinary electric systems modeling platform
- Integration of top-down and bottom-up models of the energy-economic system
- Coordinated investments in centralized and distributed resources
- Holistic analysis of the transition of electric power systems

Legend:

- Investments Loop
- Energy-Economic Loop
- Security Loop
- CentIV: Transmission and Dispatch
- DistIV: Distribution System and Generation
- eMark: Energy Markets
- GemEI: Economy
- Cascades: System Security

- ### Next steps
- Alignment of data
 - Technical connection of the models
 - Determine sector-coupled energy system pathways
 - Evaluate Pathways regarding holistic assessment of environmental impacts

- ### Questions to be answered by the connection
- How can supply and demand be balanced? What flexibility options are needed?
 - How does an increased sector coupling effect the electricity system in future energy systems in detail?
 - How do the results of a detailed electricity system model differ from the results of a less detailed but sector-coupled energy system model?
 - Are there environmental co-benefits or environmental burden shifting in a transition to net-zero?

REFERENCES

1 Reinert C., Schellhas L., Mannhardt J., Shu D. Y., Kämper A., Baumgärtner N., Deutz S., Bardow A. (2022). SecMOD: An Open-Source Modular Framework Combining Multi-Sector System Optimization and Life-Cycle Assessment. *Frontiers in Energy Research*, 10, 884525.

2 Gjorgiev B., Garrison J. B., Han X., Landis F., van Nieuwkoop R., Raycheva E., Schwarz M., Yan X., Demiray T., Hug G., Sansavini G., Schaffner C. (2022). Nexus-e: A platform of interfaced high-resolution models for energy-economic assessments of future electricity systems. *Applied Energy*, 307, 118193.

CONTACT

Ludger Leenders
Energy & Process Systems Engineering
leendersl@ethz.ch
<https://epse.ethz.ch/>

[@EPSE_ETH](https://twitter.com/EPSE_ETH)

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

Work Package 1

Euro-Calliope and the integration of Smart Charging Mechanisms into Calliope framework



Francesco Davide Sanvito¹, Francesco Lombardi¹, Bryn Pickering², Stefan Pfenninger¹

¹ Faculty of Technology, Policy and Management (TPM), Delft University of Technology, Delft, the Netherlands

² Institute for Environmental Decisions, Department for Environmental Systems Science, ETH Zürich, Zürich, Switzerland

Diversity of options to achieve carbon-neutrality and energy self-sufficiency in Europe¹

With the **SPORES** method and the **Euro-Calliope** model, we generate **441 technically feasible and cost-effective options** (○) for an energy self-sufficient, carbon-neutral Europe

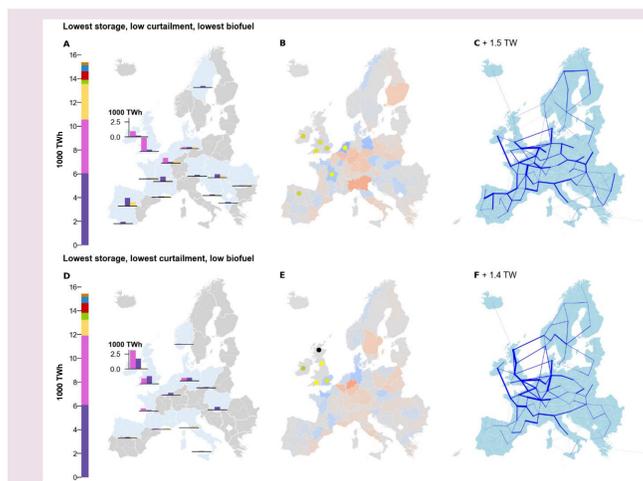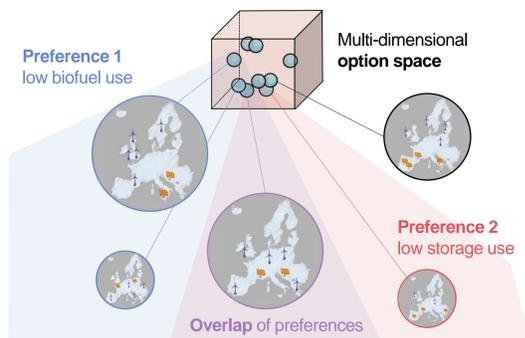

Overlap of preferences



Almost anything is technically possible, but **preferences** restrict the spatial and technical maneuvering space

When many preferences overlap, such as 'low storage use' and 'low biofuel use' some features become must-haves

For instance, a strong deployment of wind generation in Britain and Ireland



With **4 example SPORES** we illustrate here the synergies and trade-offs that may open up between plausible real-world competing stakeholder goals across a number of pre-defined metrics

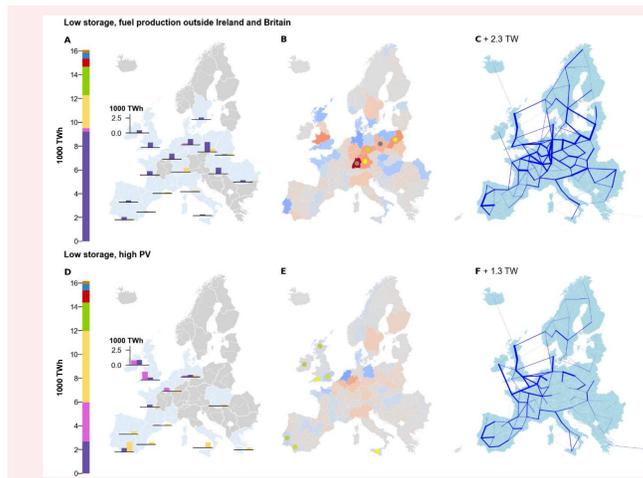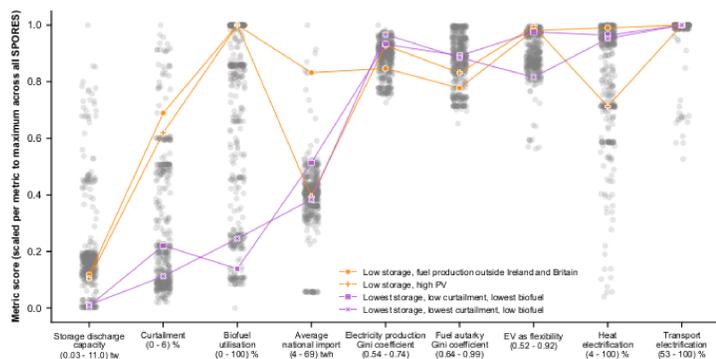

Preference 2 only

More relaxed preferences, say not limiting the use of (residual) biofuels, lead to **radically different spatial configurations**

Hubs for the production of **hydrogen** and synthetic fuels could be moved to **Eastern Europe**; or to the **Mediterranean** alongside a larger deployment of solar generation

Explore further trade-offs yourselves, with our interactive data explorer! explore.callio.pe

Integrating Smart Charging Mechanisms into Calliope energy system modelling framework


The integration of **Smart Charging Mechanisms** into **Calliope** which has been first tested on a national case study will be extended to the **European context**.

METHODOLOGY

We add novel constraints into Calliope to model the deployment of both unidirectional (**V1G**) and bidirectional (**V2G**) charging infrastructures as **competing technologies**.

CASE STUDY

We consider the **Italian power sector-only model** projected to 2050 assuming **100% EV car fleet**.



	BESS	CCGT syngas	Electrolyzers	Inter-zonal transmission	Methanation + DAC	PV farm	PV rooftop	Wind on-shore	Wind off-shore
UNCOORDINATED CHARGING	283	13	21	86	17	46	302	95	33
V1G - high cost	90	7	8	78	7	46	149	78	20
V1G - low cost	68	12	8	79	7	46	152	74	18
V1G + V2G - high cost	90	7	8	78	7	46	149	78	20
V1G + V2G - low cost	43	14	7	79	6	46	156	70	17
V1G + V2G - cost parity	0	6	7	80	6	46	162	66	17

Capacity deployment variation: +100%, 0%, -100%


Installed capacity [GWh or GW]

Installed capacity in the Reference case

Installed capacity relative change with respect to the Reference case

RESULTS

- V2G shows the potential of completely displacing BESS techs
- Reduction of installed capacity of VRES techs.
- Reduction of electricity curtailment (-40%/-50%)

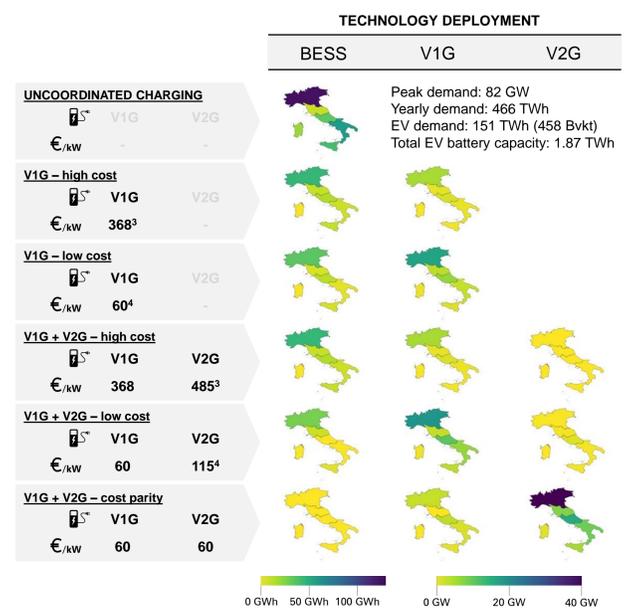

REFERENCES

- Pickering, Lombardi, Pfenninger (2022). Diversity of options to eliminate fossil fuels and reach carbon neutrality across the entire European energy system. Joule. doi.org/10.1016/j.joule.2022.05.009.
- Sanvito (2022). Assessment of sector-coupling synergies between electric vehicles and energy sector in decarbonization pathways. PhD thesis. <http://hdl.handle.net/10589/189826>.
- Steward (2017). Critical Elements of Vehicle-to-Grid (V2G) Economics. nrel.gov/docs/ty17osti/69017.pdf.
- Huber, De Clerck, De Cauwer, Sapountzoglou, Coosemans, Messagie (2021). Vehicle to Grid Impacts on the Total Cost of Ownership for Electric Vehicle Drivers. World Electric Vehicle Journal. doi.org/10.3390/wevj12040236.

CONTACT

Francesco Davide Sanvito
Technische Universiteit Delft
Faculty of Technology, Policy and Management (TPM)
F.Sanvito@tudelft.nl
www.sweet-pathfnr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.

Electric vehicles in a spatial-explicit EXPANSE electricity system model

Work package 1

Zongfei Wang, Jan-Philipp Sasse, Evelina Trutnevyte

Renewable Energy Systems, Institute for Environmental Sciences (ISE), Section of Earth and Environmental Sciences, University of Geneva, Switzerland

INTRODUCTION


Currently, Switzerland plans to phase out its nuclear power plants and hence needs to invest more in new renewable electricity generation [1]. To achieve the goal of net zero emissions by 2050, Switzerland also needs to decarbonize its transport sector by increasing the uptake of electric vehicle (EV), e.g., reaching 50% of plugged-in vehicles in new registration by 2025 [2]. Electricity demand for EVs will hence increase the requirement for renewable electricity generation.

If EV charging behaviors are uncontrolled, they would be temporally homogeneous, and the high charging demand peak could challenge the grid. With controlled charging, EV's load shifting flexibility can be utilized to promote renewable generation integration [3].

Compared with conventional centralized powerplants, renewable generation (such as solar PV and wind) is more constrained in space and generation capacity is thus spatially uneven in cost-efficient future scenarios or in real systems [4, 5]. In addition, the level of EV adoption registration is also spatially uneven (whether by EV registration number or by market share) [6].

Therefore, the heterogeneous spatial allocation of renewable generation and EV calls for the development of a spatially-explicit electricity system model to explore the potential synergy between renewable investment and EV flexibility for Switzerland.

Electric vehicle charging strategy

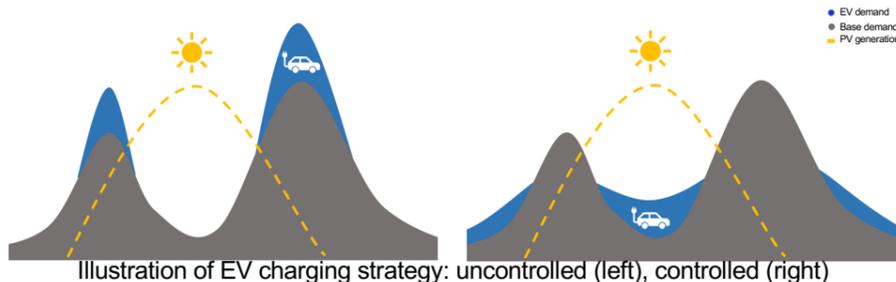

With uncontrolled charging, EV demand can be temporally homogenous, and further increase demand peak. With controlled charging, EV demand could be shifted to the mid-day or nighttime in order to flatten the demand curve or better utilize renewable energy generation.

Here, we aim to see how EV charging flexibility may promote PV generation in Switzerland. With EXPANSE, we could explore such potential transition from a systematic view for the whole country but with municipality level detail.

Scenarios of EV charging strategies (or modes) may consider: 1) charging at home or workplace, i.e., EV demand would not only shift temporally but also spatially among municipalities; 2) EV development in the future, including market share, charging power, EV battery capacity and energy efficiency; 3) user acceptance of different EV charging schemes; 4) further interaction with stationary battery storage to see whether there may be some synergy or substitution effect between EV and stationary battery technologies.

REFERENCES

- [1] Swiss Office of Energy, "Energy Strategy 2050." <https://www.bfe.admin.ch/bfe/en/home/politik/energiestrategie-2050.html>
- [2] Roadmap Elektromobilität, "Roadmap Elektromobilität 2025 | Gemeinsam viel in Bewegung gesetzt / Roadmap Elektromobilität 2025." <https://roadmap-elektromobilitaet.ch/de/>
- [3] L. Xu, H. Ü. Yilmaz, Z. Wang, W.-R. Pogonietz, and P. Jochem, "Greenhouse gas emissions of electric vehicles in Europe considering different charging strategies," *Transportation Research Part D: Transport and Environment*, vol. 87, p. 102534, Oct. 2020
- [4] J. Müller and E. Trutnevyte, "Spatial projections of solar PV installations at subnational level: Accuracy testing of regression models," *Applied Energy*, vol. 265, p. 114747, May 2020
- [5] J.-P. Sasse and E. Trutnevyte, "Distributional trade-offs between regionally equitable and cost-efficient allocation of renewable electricity generation," *Applied Energy*, vol. 254, p. 113724, Nov. 2019
- [6] Bundesamt für Statistik Statistischer Atlas der Schweiz, "Karte: Elektrofahrzeuge 2021 [Politische Gemeinden]." https://www.atlas.bfs.admin.ch/maps/13/de/16504_15115_164_3114/25801.html
- [7] J. F. DeCarolis, "Using modeling to generate alternatives (MGA) to expand our thinking on energy futures," *Energy Economics*, vol. 33, no. 2, pp. 145–152, Mar. 2011
- [8] J.-P. Sasse and E. Trutnevyte, "Regional impacts of electricity system transition in Central Europe until 2035," *Nat Commun*, vol. 11, no. 1, p. 4972, Oct. 2020
- [9] E. Trutnevyte, "Does cost optimization approximate the real-world energy transition?," *Energy*, vol. 106, pp. 182–193, Jul. 2016

METHODOLOGY

The EXPANSE modeling framework

EXPANSE is a spatially-explicit, bottom-up, technology-rich electricity system model. EXPANSE models the Swiss electricity system at the municipal level (2148 municipalities) with an hourly resolution to explore the scenarios of electricity sector transition for the single year 2035 or 2050 [5, 8].

The key feature of EXPANSE is municipality-specific decisions for renewable generation allocation instead of having a central planner at the federal level.

EXPANSE includes spatially-refined data for key centralized generation technologies (e.g., large hydro power dams and gas power plants) and distributed renewable generation technologies (e.g., solar, wind turbines and biomass).

In addition to analyzing the least-cost transition pathway, EXPANSE explores hundreds or thousands of near-optimal spatial allocation scenarios with Modeling to Generate Alternatives (MGA) technique [9].

Additional impacts of these scenarios are further analyzed from the environmental and societal aspects, including regional equity, greenhouse gas emissions, particulate matter emissions, land use, investment and divestment, price, and employment.

NEXT STEPS

Disaggregate the EV sector of EXPANSE to the municipality level

Refine EV uncontrolled charging profiles based on available research (e.g., differentiate profiles for weekdays and weekends)

Further develop the EV module to enable different EV controlled charging strategies (unidirectional or bidirectional) to endogenously determine EV charging behaviors

Include EV data to support the modeling of controlled charging strategies above (e.g., EV temporal and spatial usage profiles, EV's access to charging infrastructure, users' acceptance for controlled charging)





Explore how EV's load shifting flexibility may influence PV adoption in Switzerland under different EV scenarios (e.g., adoption level, charging strategies, technology development)

CONTACT

Zongfei Wang
Renewable Energy Systems Group
University of Geneva,
Phone: +41 (0)22 379 04 09
Email: zongfei.wang@unige.ch
Website: www.unige.ch/res

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDP consortium.

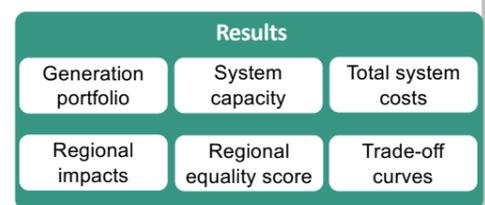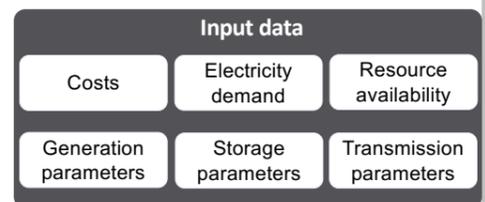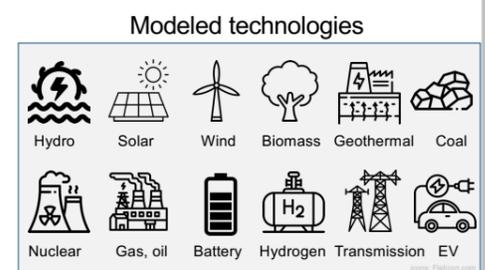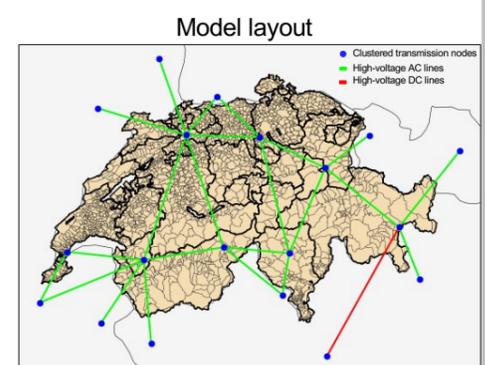



Transition Paths towards a CO₂-based Chemical Industry within a Sector-Coupled Energy System

Patricia Mayer¹, Ludger Leenders¹, David Yang Shu¹, Benedikt Winter^{1,2}, Christian Zibunas², Christiane Reinert², André Bardow¹

¹Energy & Process Systems Engineering, ETH Zürich, Switzerland

²Institute of Technical Thermodynamics, RWTH Aachen University, Germany

1 Challenge: Chemical Industry Decarbonization


5.8% of global energy demand for chemicals [1]

Chemicals will be the largest driver for increased oil demand [2]

Chemical industry 10% of global GHG emissions in 2030 [3, 4]

Net-zero chemical industry needed for net-zero GHG targets

CCU for net-zero chemicals?

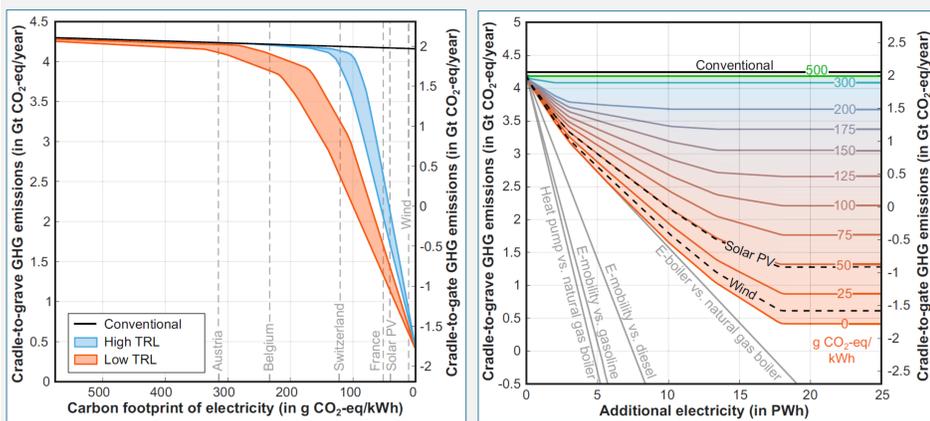


CCU enables net-zero chemicals [4]

CCU requires a lot of clean electricity – in competition with other sectors [4]

Need to evaluate CCU potential within a sector-coupled system

2 Methods: German Energy System Optimization

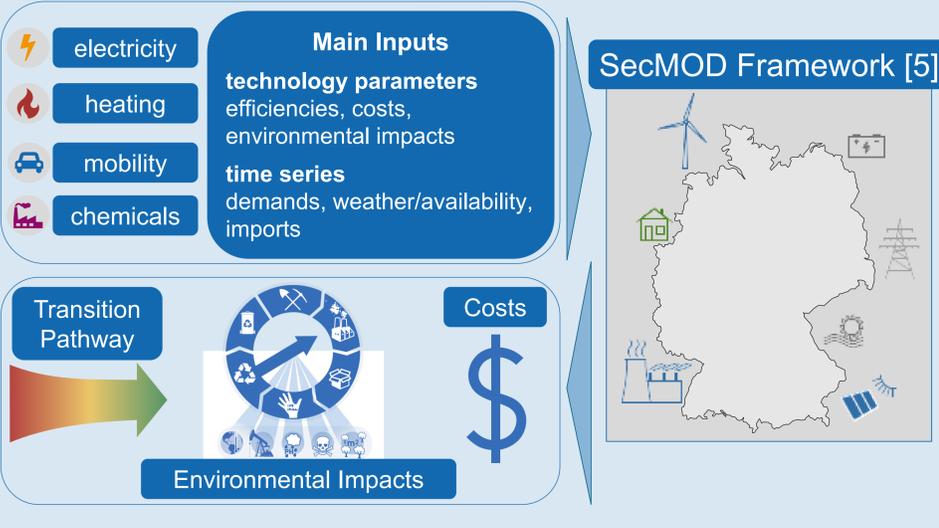

4 Conclusions


Clean electricity deficit for net-zero island German energy system → imports required

CO₂-based chemical industry transitions last along with high-temperature heat

Methanol important intermediate for CO₂-based chemicals



3 Results and Discussion

German Clean Electricity Balance for Net-Zero System

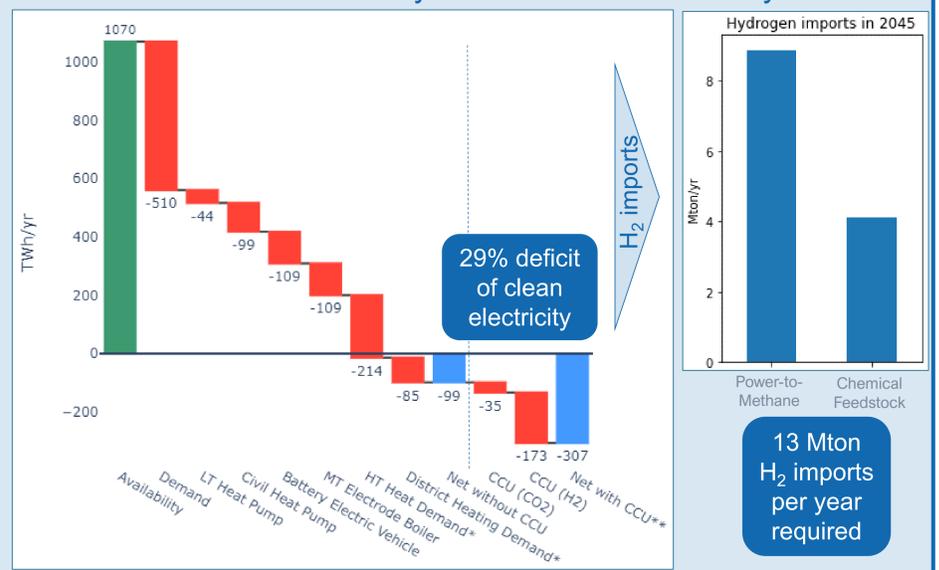

*Raw heat demand without conversion from heat-generating technology
**CCU demands do not include direct process electricity or heat demands


Sector-Coupled System Transition

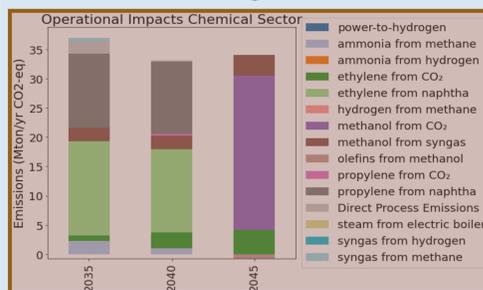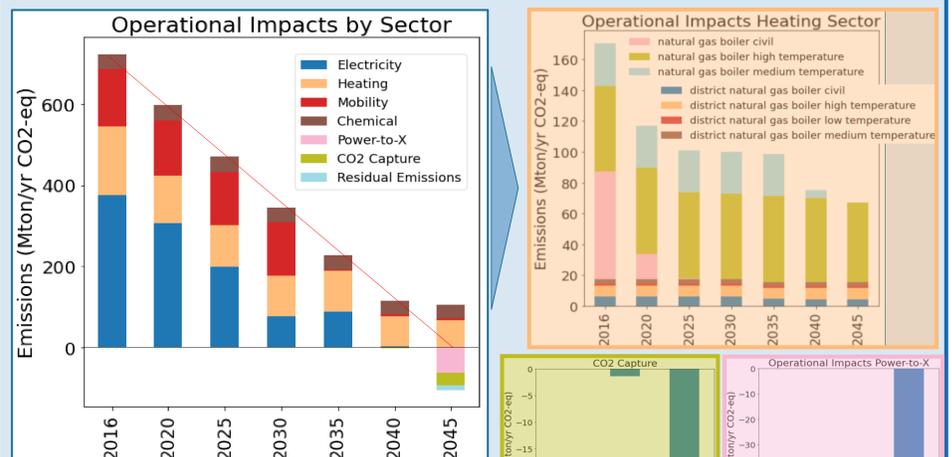

Chemical industry transitions last along with high-temperature heat

Direct air capture and power-to-methane important for net-zero system

Chemical Industry Transition

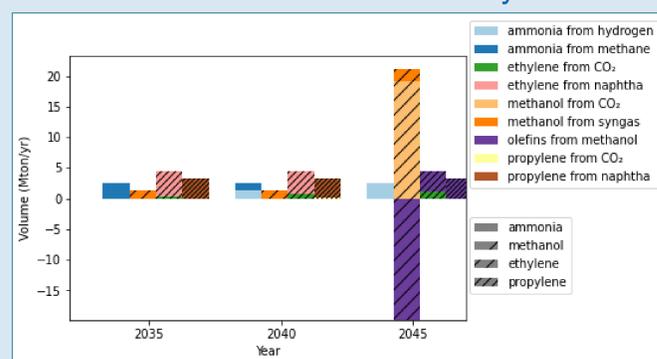

Chemical industry transition begins only in 2040...

... but fully CO₂-based in 2045

Methanol important intermediate product

References

- IEA (2017): Tracking Clean Energy Progress 2017. Paris.
- IEA (2018): The Future of Petrochemicals: Towards More Sustainable Plastics and Fertilisers.
- International Energy Agency (2021): Global Energy Review 2021. Assessing the effects of economic recoveries on global energy demand and CO₂ emissions in 2021. IEA Publications.
- A. Kätelhön, R. Meys, S. Deutz, S. Suh, A. Bardow, 2019, Climate change mitigation potential of carbon capture and utilization in the chemical industry, PNAS, 116, 23, 11187–11194
- N. Baumgärtner, S. Deutz, C. Reinert, N. Nolzen, L. E. Kuepper, M. Hennen, D. E. Hollermann, A. Bardow, 2021, Life-Cycle Assessment of Sector-Coupled National Energy Systems: Environmental Impacts of Electricity, Heat, and Transportation in Germany Till 2050, Front. Energy Res., 9.

Acronyms

- CCU: Carbon Capture and Utilization
LT: Low Temperature
MT: Low Temperature
HT: High Temperature
DAC: Direct Air Capture

Contact



Patricia Mayer
Tannenstrasse 3
8092 Zürich
+41 44 633 88 51
patmayer@ethz.ch
https://epse.ethz.ch/

Acknowledgements



This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the "PATHFNDR" consortium.

Cyber-physical platforms: conceptual foundations and empirical case study

Work package 6

Giacomo Melegati¹, Johannes Meuer^{1, 2}, Stefano Coiro³

¹ Chair of Sustainability and Technology (SusTec), Department of Management Technology and Economics, ETH Zurich, Switzerland

² Center for Sustainable Logistics and Supply Chains, Kühne Logistics University, Germany

³ Enel X S.r.l., Rome, Italy

1 ABSTRACT

Platforms are one of the most discussed topics in recent management literature, and for good reasons. Some of the world's most successful companies are platforms, thanks to their abilities to generate network effects and foster innovation. However, research mostly focuses on digital platforms, creating the misconception that only companies relying on software-based technologies can establish platform ecosystems. To the contrary, cyber-physical platforms already find many innovative applications in various industries. We first investigate the characteristics of cyberphysical platforms, evaluate the effects of these characteristics on their mechanisms of value creation and innovation, before comparing them to those of digital platforms. We provide a first definition of cyber-physical platforms and highlight that the mechanisms of value creation and innovation of cyber-physical platforms significantly differ from those of digital platforms.

2 CONTRIBUTION TO PATHFNR

Contribution to work package 6, Task 3: Technological innovation and the interplay between firms at value chain level.

- Milestone M6.3.1: Strategically important technologies (physical vs. digital; core vs. peripheral) identified and analyzed
- Deliverable D6.3: Submission of two peer-reviewed papers on response innovation processes, and business models and decision-making tools. → Writing process for paper contribution.

2 RESEARCH QUESTION AND METHODOLOGY

In the last 30 years, researchers of various disciplines have investigated the topic of platforms. In recent years there have been several new platforms that rely on technologies such as automated control systems, cloud computing, additive manufacturing, machine-to-machine communication and the internet of things (IoT). Meuer et al. (2019) identifies these platforms as "cyber-physical", for they are made of both physical and digital components. Despite their various applications and socio-economical relevance, researchers studied cyber-physical platforms only from a technological perspective (Cusumano et al., 2019; Gunes et al., 2014; Sanislav & Miclea, 2012). Research has failed to examine in detail the nature of cyber-physical platforms and their innovation and value creation dynamics. Therefore, we ask:

- *What are cyber-physical platforms?*
- *What are the effects of their physical features on innovation and value creation patterns and how do these patterns compare to those of digital platforms?*

We divided the research process in two stages; a theoretical study and an empirical in-depth case study. First, we collected data through literature review. For the second stake, we collected data from our case Enel X, the customer solutions unit of a global utility provider. Enel X provides services from urban application such as e-city, smart home and electrical mobility. We conducted 15 interviews as primary data and collected company documentation as secondary data. We analyzed the case study following an inductive methodology.

3 RESULTS


Platform literature started in the early 90s with the product design view. This stream of literature on platforms focused on innovation, looking at the modularity of design. In the first half of 2000, the economic view on platform was developed. Using the concepts of network effects and multi-sided platforms, the research stream focused on competition and competitive advantage. Baldwin and Woodard (2009) introduced the 'unified view,' defining that all platforms are made of a core and a periphery. Gawer (2014) introduced the openness of platforms. While the engineering and economic focus dominated the literature on platforms, the context was mainly on purely digital platforms, leaving out the discussion on cyber-physical platforms. From the literature analysis and our interview, we define cyber-physical platform as follows:

"Cyber-physical platforms are modular technological architectures, that differ in their degree of automation and control, in which information flows bilaterally from the physical world to the digital space to connect various devices and agents in an open ecosystem"

Key Elements of a cyber-physical platform are:
Modularity, automation & control, connectivity & information flow, and inclusion into ecosystem.

We learned that cyber-physical platforms differ from digital platforms in terms of innovation pattern, value creation & competition, and unique challenges they face.

- Cyber-physical platforms require only incremental innovation to build the infrastructure but rely on radical innovation for platform adoption.
- Cyber-physical platforms rely on a high density of device to constitute the platform and range of service. Competition of new entrants from both physical and digital side makes it very hard recognize potential threats as competitors are most of the times unknown.
- Cyber-physical platforms face unique challenges such as high capital requirements and long sales cycles creating difficulties in scaling the business.

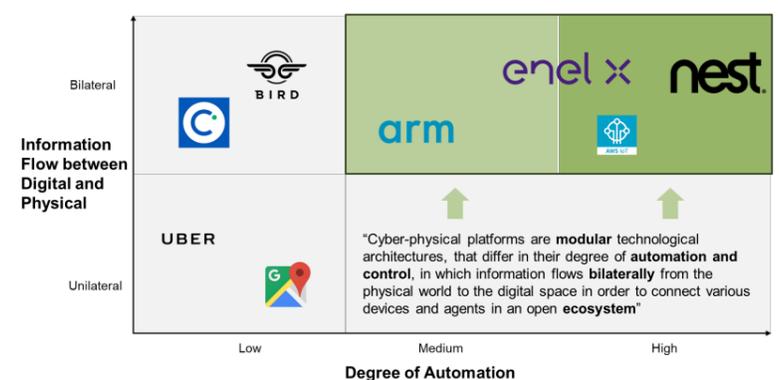

What makes a cyber-physical platform?

	CYBER-PHYSICAL PLATFORMS	DIGITAL PLATFORMS
Innovation Pattern	<ul style="list-style-type: none"> • Incremental innovation to build infrastructure • Radical innovation to make shift towards platform adoption 	<ul style="list-style-type: none"> • Same core technological features, new linkages of knowledge • Architectural innovation pattern
Value Creation & Competition	<ul style="list-style-type: none"> • Density of devices constituting the platforms is major driver to give great range of services • Competition of new entrants from both physical and digital side makes hard recognizing threats 	<ul style="list-style-type: none"> • Importance of network effects as source of competitive advantage • Low capital requirements allow scalability
Unique Challenges	<ul style="list-style-type: none"> • High capital requirements and long sales cycles creating difficulties in creating scalable businesses • More varied data result in greater data management and enrichment efforts needed 	<ul style="list-style-type: none"> • Possibility of platform partners to become competitors for control • Lack of infrastructure requirements facilitates interplatform competition

Comparison cyber-physical platform vs. digital platforms

REFERENCES

- Baldwin, C. Y., & Woodard, C. J. (2009). The architecture of platforms: A unified view. *Platforms, markets and innovation*, 32, 19-44.
- Gawer, A. (2014). Bridging differing perspectives on technological platforms: Toward an integrative framework. *Research Policy*, 43(7), 1239-1249.
- Meuer, J., Toetzke, M., Nakhle, C., & Windeck, S. (2019). A typology of digital building technologies: Implications for policy and industry. *IOP Conference Series: Earth and Environmental Science*, 323(1).

CONTACT

Johannes Meuer
Chair of Sustainability and Technology
ETH Zurich, Switzerland
Phone: +41 44 632 29 83
jmeuer@ethz.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

Cross-sectoral collaboration for a green hydrogen value chain

Work package 6

Annegret Stephan^{1,2}, Katharina Wildgruber^{1,3}, Johannes Meuer⁴, Martin Wietschel²

¹ Chair of Sustainability and Technology (SusTec), Department of Management Technology and Economics, ETH Zurich, Zurich, Switzerland

² Competence Center Energietechnologien und Energiesysteme, Fraunhofer-Institut für System- und Innovationsforschung ISI, Karlsruhe, Germany

³ Institute for Industrial Production, Department of Economics and Management, Karlsruhe Institute of Technology KIT, Karlsruhe, Germany

⁴ Center for Sustainable Logistics and Supply Chains, Kühne Logistics University, Hamburg, Germany

1 ABSTRACT

The development, diffusion, and use of sector coupling technologies such as green hydrogen play an integral role in achieving the climate targets of the Paris Agreement. To ensure a reliable transition towards a sector-coupled energy system, many actors from diverse sectors need to collaborate. However, the characteristics of cross-sectoral collaboration in sector coupling technologies have yet been underexplored. In this study, we analyze 125 European projects which jointly cover the entire green hydrogen value chain. Using fuzzy-set Qualitative Comparative Analysis, we identify four project feature configurations that are associated with cross-sectoral diversity in collaborations: the Mega, the Big & Local, the Non-International, and the Commercial Project archetype. The occurrence of these archetypes varies along the green hydrogen value chain. Our findings suggest that cross-sectoral diversity should be fostered in industry and cross-cutting (standardization, safety, education, recycling) projects and that it can be addressed by policymakers through the targeted promotion of certain project features.

2 CONTRIBUTION TO PATHFNDR

Contribution to work package 6, Task 2: Technological innovation and the interplay between firms at value chain level.

- Milestone M6.2.1: Technology value chains identified and understood, linkages due to sector coupling identified and analyzed.
- Deliverable D6.2: Submission of three peer-reviewed papers on business interests, value chain processes, and innovation strategies. → Writing process for paper contribution.

2 RESEARCH QUESTION AND METHOD

As sector coupling technologies like those deployed in the field of green hydrogen will serve multiple established sectors simultaneously, they will become integral elements across several sectors. This distinct characteristic goes beyond those of traditional (i.e., non-sector-coupling) technologies, and is likely to require substantially different innovation processes. On the one hand, studies in this field have analyzed regulatory framework conditions but have provided limited insights into innovation processes. On the other hand, more general innovation studies have examined innovation in individual technologies for single sector applications, but innovation processes for sector coupling remain widely unexplored. Therefore, we ask:

- What configurations of project features are associated with cross-sectoral diversity in collaborations for green hydrogen?
- How do these collaborative patterns vary along the value chain?

Method: fuzzy-set Qualitative Comparative Analysis (fsQCA), expert interviews

Data: 125 green hydrogen projects from FCH JU database, 7 expert interviews

3 RESULTS

We analyzed the hydrogen value chain, which is end-used in the three areas: Transport, industry and building heat.

The highest participation of project partners for green hydrogen stems from Germany, France, Italy, and the UK. An overall high involvement of research and education institutions exists in the projects (see total project participation). This involvement is more distinct at some value chain stages (cross-cutting, generation, storage, fuel cell development) than at others. This indicates that an overall high level of early-stage innovation in green hydrogen exists, especially in the mentioned value chain stages.

We identified 4 archetypes of green hydrogen projects with different permutation.

1. The Mega Project

High project cost, many project partners.

2. The Big Local Project

Many project partners, very local project consortium. Not long project duration.

3. The Few Nationalities Project

Two subtypes:

3a Local: Very local project consortium. Not very international project consortium.

3b Big, short-term: Many project partners, not very international project consortium, no long project duration.



4. The commercial project

Three subtypes, all high share of commercial partners and following and additional:

4a Local: Very local project consortium.

4b Expensive, international: High project costs, very international project consortium.

4c Short-term, international: no long project duration, very international consortium.

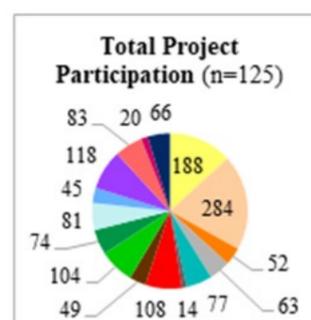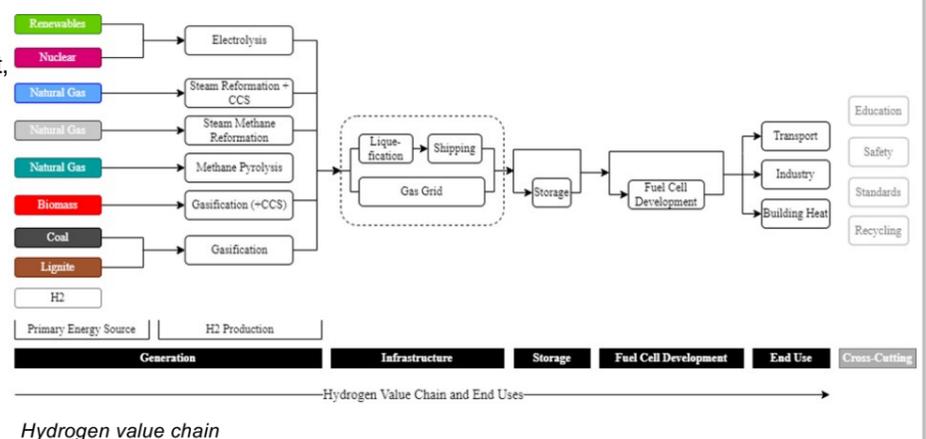

Sectoral involvement of project partners of the green hydrogen value chain

REFERENCES

Wildgruber, K., (2022), Cross-sectoral collaboration for a green hydrogen value chain, Master Thesis, KIT Karlsruhe/ETH Zurich.

CONTACT

Dr. Annegret Stephan
Chair of Sustainability and Technology
ETH Zurich, Switzerland
astephan@ethz.ch
www.sweet-pathfnldr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.

Optimal design of hydrogen supply chains to decarbonize hard-to-abate industry in Europe


Work package 1.2

Alissa Ganter, Paolo Gabrielli, Giovanni Sansavini
Institute of Energy and Process Engineering, ETH Zurich, 8092 Zurich, Switzerland

1 INTRODUCTION AND MOTIVATION

Opportunity: Hydrogen have the potential to decarbonize hard-to-abate industrial sectors such as ammonia production and refineries¹

Challenge: The lack of a European hydrogen supply chain infrastructure prevents the widespread use of low-carbon hydrogen^{2,3}

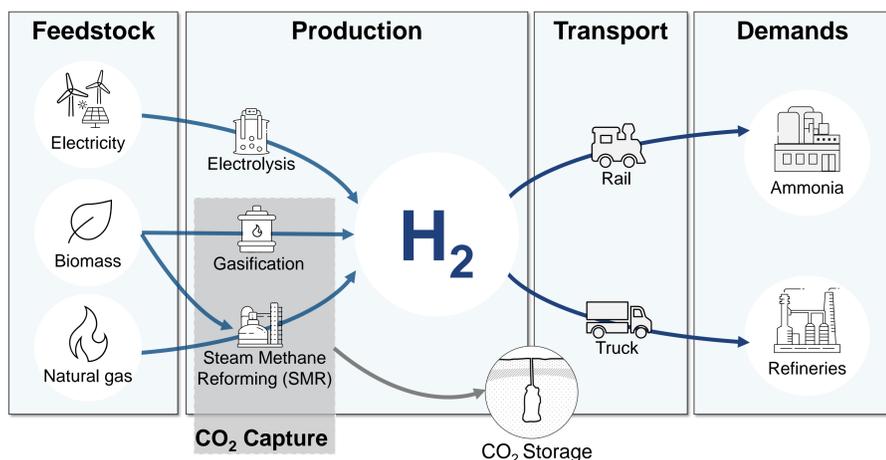

2 PROBLEM FORMULATION

Input Data

- Hydrogen demands for ammonia production and refineries²
- Resource availabilities³ and cost
- CO₂ storage locations and capacities
- Technology data (capital, operational expenditures, conversion efficiencies)

Mixed integer linear program⁴

$$\begin{aligned} \min_{x,y} \quad & c(x, y) \\ \text{s. t.} \quad & g_i(x, y) \leq b, \forall i \in I \\ & h_j(x, y) = 0, \forall j \in J \\ & x \in \mathbb{R}^N, y \in \{0,1\}^M \end{aligned}$$

Objective: Minimize total costs


Constraints: Mass and energy balances
Carbon emissions constraint
Technology constraints

Model output


Optimal type, size, and location of the hydrogen production and transport technologies over a multi-year time horizon with respect to decarbonization targets

3 OPTIMAL HYDROGEN SUPPLY CHAIN DESIGN


Spatially-resolved input data²

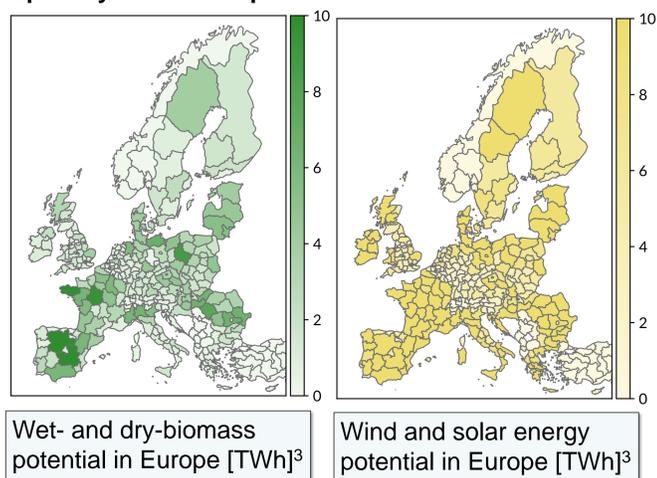


Hydrogen production [TWh] and transport to reach carbon neutrality by 2035 (CN2035)

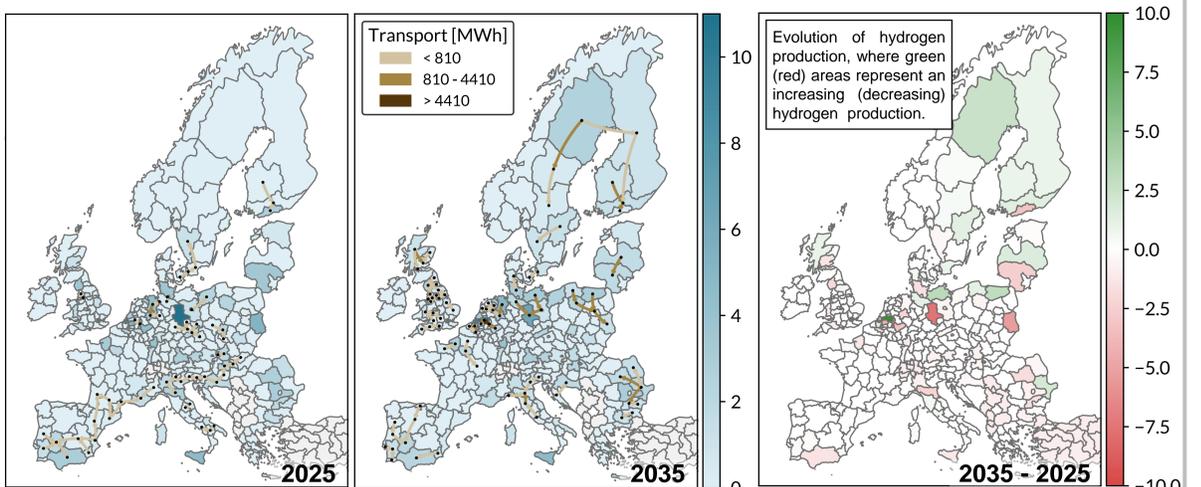

Levelized cost of hydrogen and cumulative emissions

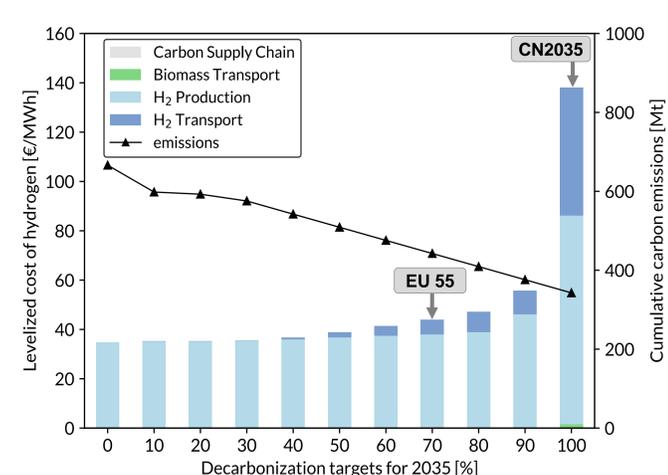

Optimal hydrogen production technology mix from 2025 to 2035 for EU55 and minCO₂

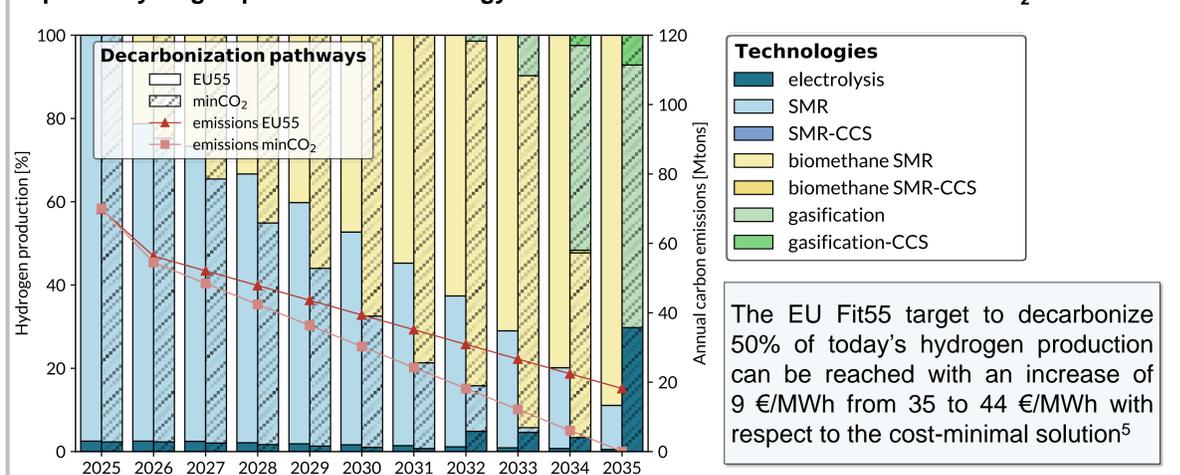

The EU Fit55 target to decarbonize 50% of today's hydrogen production can be reached with an increase of 9 €/MWh from 35 to 44 €/MWh with respect to the cost-minimal solution⁵

4 CONCLUSIONS

- The levelized cost of hydrogen increases by 150%, from 35 €/MWh to 138 €/MWh, when increasing the decarbonization target from 90% to 100%
- The results highlight the importance of biomass-based hydrogen production in the transition from fossil-based hydrogen production to low-carbon hydrogen production
- A clear ranking of low-carbon hydrogen production technologies can be derived with biomass gasification being the preferred option. Biogas reforming serves as a transition technology. The role of water-electrolysis and CCS is low, due to high system costs.

REFERENCES

1. van der Spek et al., *Energy & Environmental Science* **2022**, Vol. 22
2. Kakoulaki et al., *Energy Conversion and Management*, **2021**, Vol. 228
3. Rosa et al., *Energy & Environmental Science*, **2021**, Vol. 157
4. Gabrielli et al., *Applied Energy*, **2020**, Vol 275
5. European Commission, "Fit for 55": delivering the EU's 2030 Climate Target on the way to climate neutrality, **2021**

CONTACT

Alissa Ganter
ETH Zurich
Reliability and Risk Engineering
Phone: +41 44 632 31 82
aganter@ethz.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

PSI's Energy System Integration Platform (ESI)

Work package 3 – Technology and model development

Christian Peter¹, Pascal Häfliger¹


¹Electrochemistry Laboratory, Paul Scherrer Institute, Forschungsstrasse 111, 5232 PSI Villigen, Switzerland

1 OVERVIEW ESI – RENEWABLE ENERGY STORAGE¹



• PEM based • Pure O₂ based • Intermittent operation

Fig. 1: Energy System Integration Platform – Technology demonstration on the sub MW level.

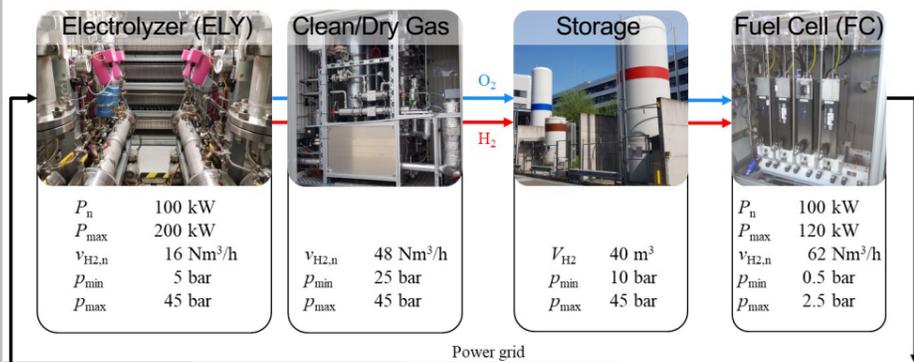

• Fully automated • ReMaP² access

Fig. 2: Hydrogen path as the backbone of ESI and the future energy system.

2 DYNAMICS OF PEM TECHNOLOGIES

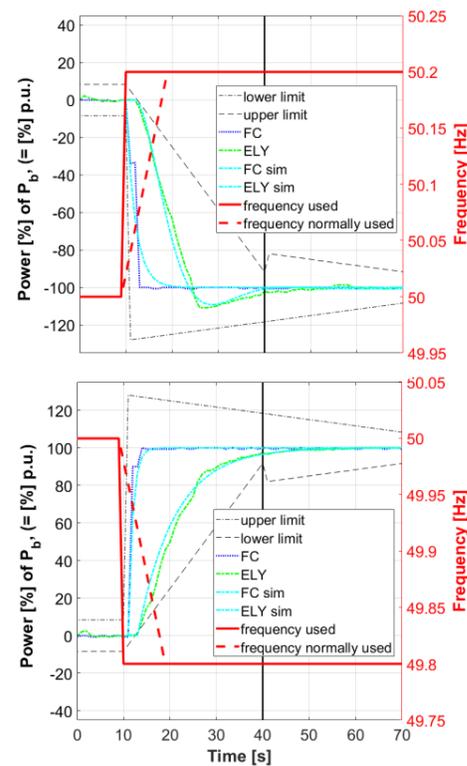


Fig. 3: Primary frequency control results for frequency increase (top) and frequency decrease (bottom).

- Tests conducted with **polymer electrolyte membrane (PEM)** technologies.
- Demonstrated synchronous grid frequency control capability.³
- Fast dynamics using pure oxygen in the processes.
- Collaboration with Swissgrid using relevant technology level.
- PEM Electrolyzer system (TRL 7) +/- 8 % p.u. / s.
- PEM Fuel cell system (TRL 5) +/- 33 % p.u. / s.
- Coming with a small droop – high controllability per unit of installed power.

3 EFFICIENCIES OF PEM TECHNOLOGIES

PEM technologies on ESI (TRL 5 – 7), measured in 2019³:



PtH₂tP PEM technologies in 2040, estimated:



Fig. 4: Roundtrip efficiency for hydrogen path on ESI (top) and for the future energy system (bottom).

- Fundamental efficiencies determined.
- Base for techno-economic assessments.
- PtH₂tP using pure oxygen.
- Higher roundtrip efficiency than with air (+ 7.5 % in near future).

Category	Losses in % of system feed entity:					
	PtG			GtP		
	2011	2040	Δ	2017	2040	Δ
BoP	5.8	3	2.8	5.6	1.2	4.4
Converter	8.0	0.5	7.5	4.0	1.4	2.5
EC	38.5	26.8	11.7	33.5	27.2	6.3
GC	0.5	0.5	0	–	–	–
GUL	–	–	–	3.6	0.24	3.4
Tot. EL	52.9	30.8	22.1	–	–	–
CDG	1.2	0.6	0.6	–	–	–
Total	54.1	31.4	22.7	46.7	30.1	16.6

Fig. 5: Development of the different losses investigated. (Balance of plant (BoP), electro-chemical (EC), gas-crossover (GC), and gas utilization (GUL)).

4 CONTRIBUTION TO PATHFNR



REFERENCES

- <https://www.psi.ch/de/media/esi-plattform>
- <https://remap.ch/platform>
- C. Peter et al., IJEPES, 141, 108121 (2022).
- B. Flamm et al., Applied Energy, 281, 116031 (2021).

CONTACT

Christian Peter
Paul Scherrer Institute
Electrochemistry Laboratory
Phone: +41 56 310 55 88
christian.peter@psi.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by Swissgrid AG, the ETH domain, and the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

MODEL DEVELOPMENT FOR ADVANCED CONTROL ALGORITHMS

Work package 3 – Technology and model development

Christian Peter¹, Lisa Morandi², Marta Fochesato³

¹Electrochemistry Laboratory, Paul Scherrer Institute, Forschungsstrasse 111, 5232 PSI Villigen, Switzerland

²Department of Mechanical Engineering, ETH Zürich, Zürich, Switzerland

³Department of Electrical Engineering, ETH Zürich, Automatic Control Laboratory, Zürich, Switzerland

1st USE CASE: OPTIMIZED HYDROGEN PRODUCTION¹

Goal: cost efficient hydrogen production for refilling fuel cell cars using PEM electrolyzer.

- PEM electrolyzer considered.
- System Identification.
- Modelling input / output relations.
- Determine system limitations.
- PEM electrolyzer model.

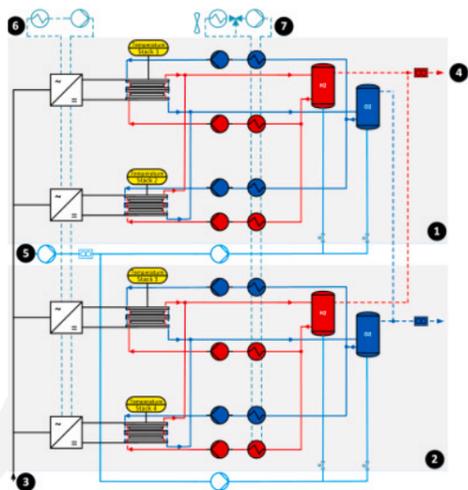


Fig. 1: Process & Instrumentation Diagram of Silyzer 100 electrolyzer.


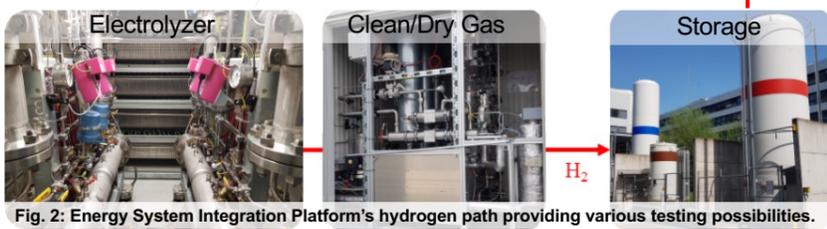



Fig. 2: Energy System Integration Platform's hydrogen path providing various testing possibilities.

2nd USE CASE: PEAK SHAVING BEV DEMAND²

Goal: reduce the daily power peak drawn from the grid to charge the incoming EVs on a parking lot.

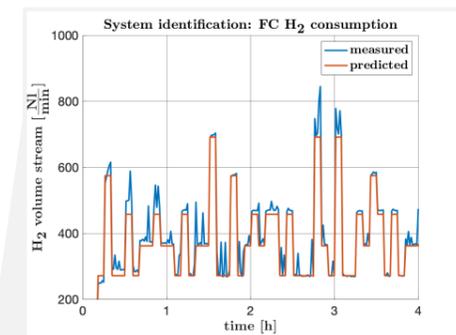

- PEM PtH₂tP considered.
- System Identification.
- Modelling input / output relations.
- Determine system limitations.
- Electricity supply by grid & onsite PV production.
- PEM PtH₂tP model.

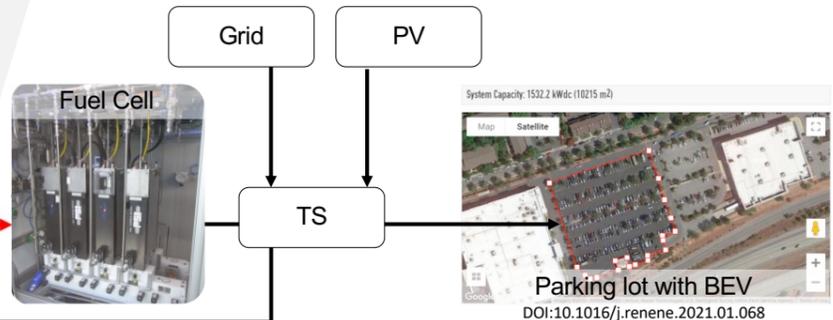

Results

- Deterministic model predictive control carried out.
- Realistic setup considered.
- Fuel cell hydrogen refilling demand & EPEX SPOT SE.
- Realization of software framework with HIL.

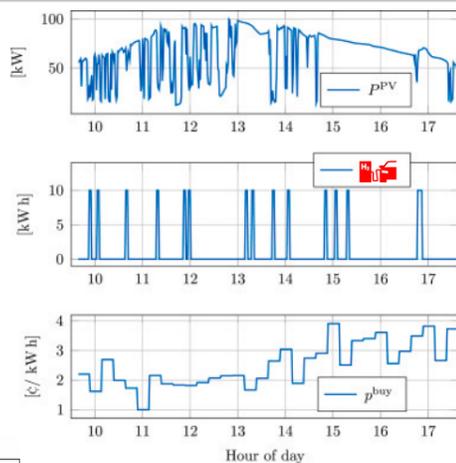


Fig. 3: Scenario settings: photovoltaic power generation (top), hydrogen demand (middle) and dynamic prices (bottom) over time considered.

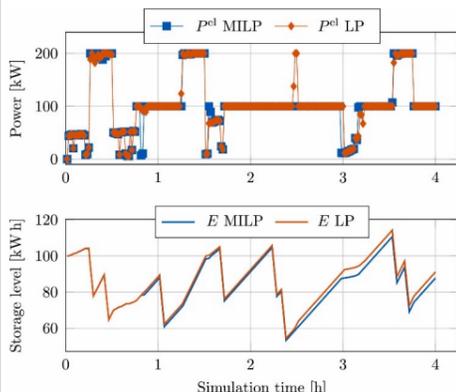


Fig. 4: HIL data with electrolyzer power and storage level over time according to the applied control algorithm.

- PEM electrolyzer model validated.
- Advanced control algorithms validated.
- Performance comparison mixed-integer linear programming problem (MILP) versus LP.
- MILP performed more cost-efficient.

Results

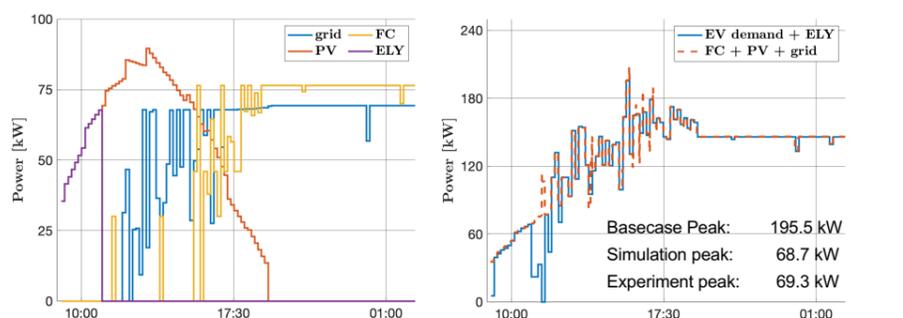


Fig. 5: HIL data with grid, fuel cell (FC), PV and electrolyzer (ELY) powers (left) – power balance check (right).

- Deterministic & stochastic model predictive control.
- Fully automated tests with HIL.
- Advanced control algorithms validated.
- Performance comparison between different algorithms.
- Simulation environment developed.

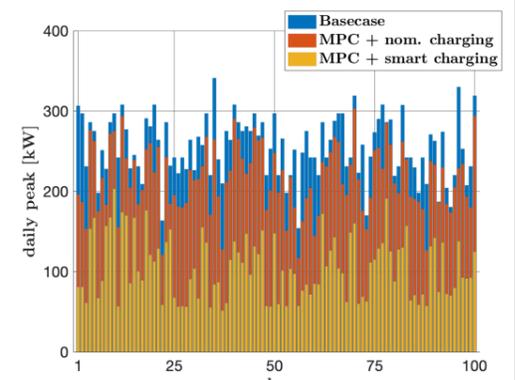


Fig. 6: Control algorithms performance in simulations with stochastic demand.

REFERENCES

- 1 B. Flamm et al., Applied Energy, 281, 116031 (2021).
- 2 https://remap.ch/project_t3-9

CONTACT

Christian Peter
Paul Scherrer Institute
Electrochemistry Laboratory
Phone: +41 56 310 55 88
christian.peter@psi.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the ETH Foundation and the Swiss Federal Office of Energy's "SWEET" programme, and was performed in the PATHFNR consortium.

Planning & operation of multi-energy systems


Work package 2 (ST1, 3.2 & ST4.1)

Adamantios Marinakis¹, C. Yaman Evrenosoglu¹, Turhan Demiray¹


¹Research Center for Energy Networks (Forschungsstelle Energienetze – FEN), ETH Zürich




INFRASTRUCTURE PLANNING FOR MULTI-ENERGY SYSTEMS (CITY, VILLAGE ETC.)

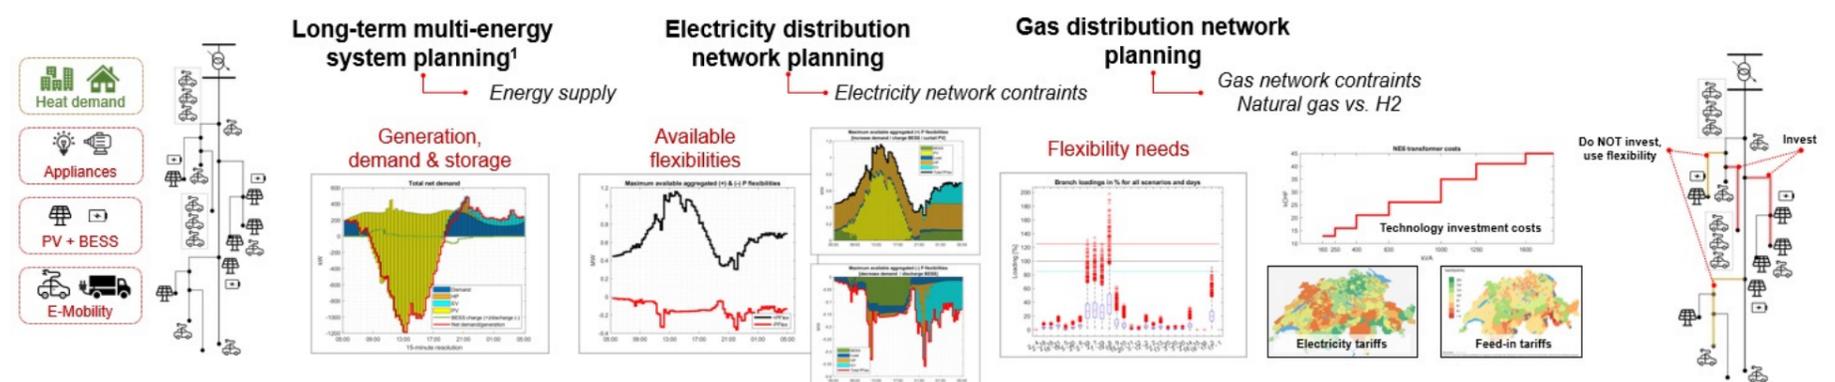

NETWORK OPERATION: SCHEDULING & UTILIZATION OF FLEXIBILITY

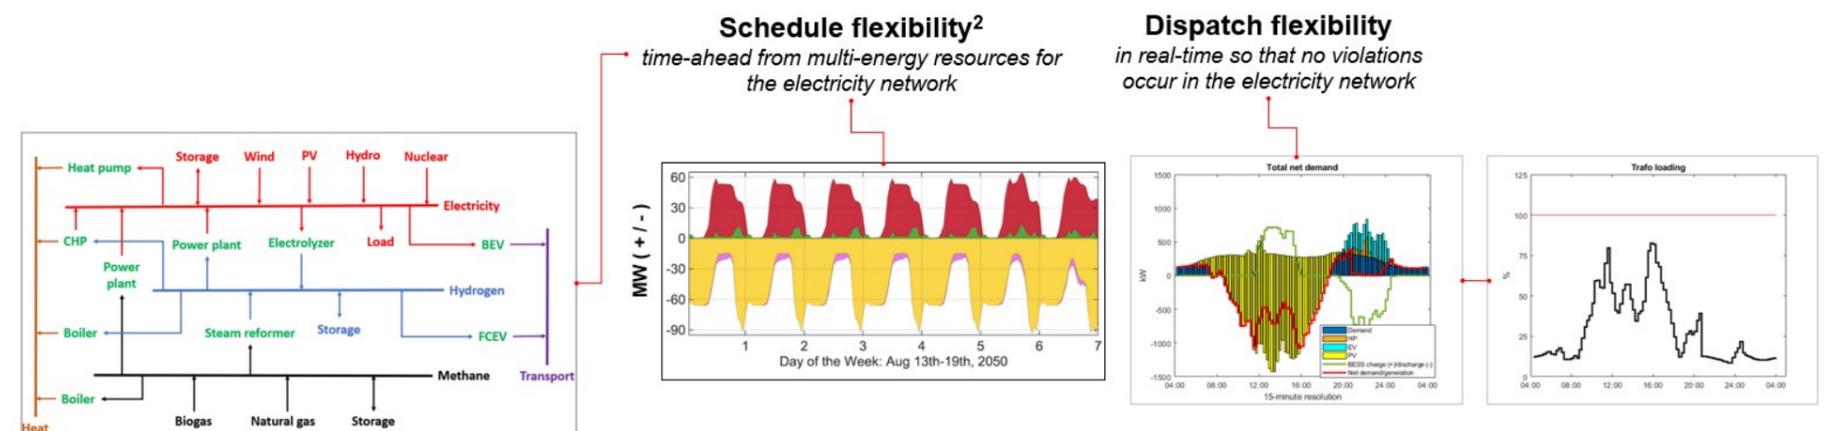

IDENTIFICATION OF USE-CASES: REPRESENTATIVE GRIDS (ELECTRICITY, GAS, HEATING) & ENERGY SCENARIOS

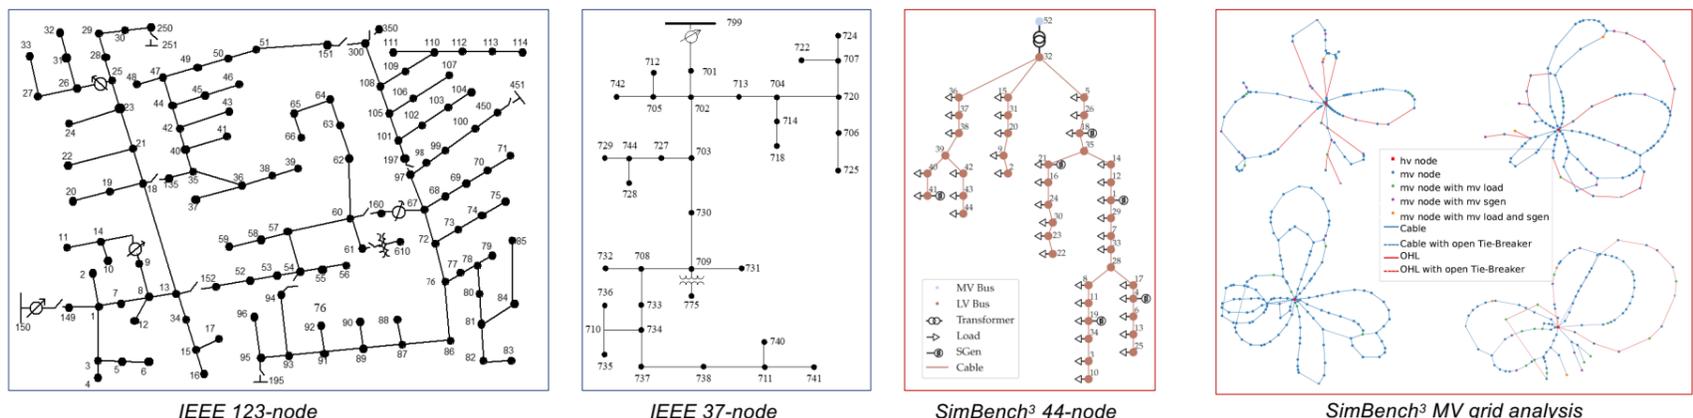

Rural, urban, mountainous regions; electricity, gas and district heating networks; type of sites / end-users; resource availability

REFERENCES

- 1 A. Marinakis and T. Demiray, Sector Coupling, SGEN Project, Final Report, 2022.
- 2 C.Y. Evrenosoglu, J. Garrison, A. Fuchs and T. Demiray, TDFlex – TSO-DSO Flexibility: towards integrated grid control and coordination in Switzerland, Swiss Federal Office of Energy, Final Report SI/501735, 2022.
- 3 S. Meinecke et al., SimBench—A Benchmark Dataset of Electric Power Systems to Compare Innovative Solutions Based on Power Flow Analysis, Energies 2020.

CONTACT

Dr. Adamantios Marinakis
Dr. C. Yaman Evrenosoglu
Research Center for Energy Networks
(FEN), ETH Zürich
Phone: +41 44 632 69 68
marinakis@fen.ethz.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.



Optimal integration of Borehole Thermal Energy Storage in district heating and cooling networks

Joel Haas^{1,2}, Massimo Fiorentini¹, Robert Weber¹, Paolo Gabrielli², Giovanni Sansavini²

¹Empa - Swiss Federal Laboratories for Materials Science and Technology
²Institute of Energy and Process Engineering, ETH Zurich

1 Motivation

Integrating a borehole thermal energy storage (BTES) into district heating and cooling networks enables cost-effective seasonal storage of waste and renewably-generated heat. The operation of such a district heating and cooling network involves a large number of decision variables and is affected by boundary conditions¹, such as the CO₂ intensity of the electricity, which varies seasonally. For this reason, an optimization formulation needs to be developed. To predict the performance of such systems, two modelling approaches are normally employed:

- High fidelity models, which simulate the detailed behavior of the networks and components for predefined parameters. (such as in TRNSYS or Modelica)
- Optimization formulations, using simplified, mostly linearized, models, to calculate optimal decision variables affecting these systems.

Due to high computational costs, no numerical approaches with detailed high-fidelity models can be solved in a reasonable time, but it is at the same time unknown how well the simplified approaches can represent these systems. This leads to the research questions of this work:

How does the optimal solution of operational parameters managing a BTES, which has to be found with simplified models, compare to the same inputs given in a high-fidelity platform?

Considering the seasonality of the CO₂ intensity of the electricity, what is the best operating temperature of the BTES, and when should be air be used as a source?

3 Methods

In a first step, a detailed model of the heating and cooling network with a time step of 1/4 hour was created in TRNSYS. With this, two baseline simulations were created. One with a low temperature BTES, with a starting temperature ($T_{BTES,initial}$) of 12 °C and a high temperature BTES at 25 °C. These two simulations serve as a benchmark. In a second step, an energy hub approach formulated as a non-convex MILP formulation was developed with Gurobi and Yalmip in Matlab. The objective was to minimize the annual CO₂ emissions, by optimally operating the network. The following 2 optimization parameters were selected.

- $T_{BTES,initial}$ (initial BTES temperature in spring)
- $T_{air,set}$ (daily mean air temperature at which the air source is prioritized over the BTES source heat pump)

This formulation takes the annual CO₂ intensity of electricity into account and approximates the BTES as a steady-state cylindrical ground storage with a uniform temperature. In addition, the maximum energy transfer rate in and out of the BTES was assumed by a constant UA value, as follows:

$$T(i+1) = T(i) + \frac{\Delta t}{M_g V_g} \left[\underbrace{\dot{Q}}_{\text{Net heat flow}} - \underbrace{U_A A_g (T(i) - T_a(i))}_{\text{Top losses}} - \underbrace{k_g h \frac{D_g}{2} (T(i) - T_g)}_{\text{shell losses}} \right] \quad \dot{Q}_{BTES,i} \leq UA_i \Delta T_i$$

To further reduce the calculation time, a daily time step was chosen.

2 Case Study

A generic district heating and cooling system, analogous to Fig. 1, was used as a case study. It has 3 networks:

- High-temperature network at 68/45°C, which is dedicated to supply the heating load. The heat is provided by 3 different heat pumps, namely an air, a waste heat and a BTES source heat pump. In case the heating demand cannot be covered by the heat pumps, a boiler is switched on as a backup.
- Medium-temperature network at 38/28 °C, is used to receive and store the rejected heat inside the BTES. In case of excess of heat during summer, the heat can also be released to the environment via a cooling tower.
- Cold network, providing cooling via a single chiller in the cooling network and has a temperature level of 6/12 °C.

A buffer is integrated within each temperature level, which enables short-term storage of heat and thus simplifies the control of the entire system.

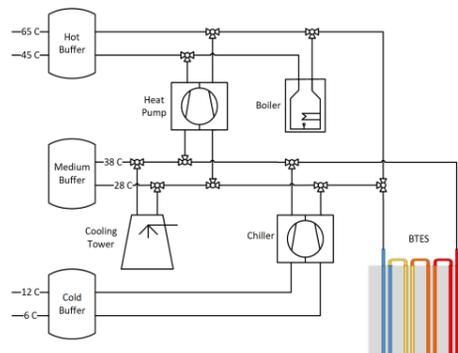


Fig. 1: Case-study system simplified sketch




Fig. 2: BTES boreholes placing²

The BTES, on the other hand, is used as long-term storage and has a diameter of 50m, a depth of 100m and consists of 144 double-U ground heat exchangers (GHXs) (Fig.2) An annual load profile of the EMPA research campus was used as input to the models. The network provides an annual heating demand of 6850 MWh and a cooling demand of 3490 MWh.

4 Results

- Comparing the high and low-temperature BTES baseline results in TRNSYS, the high temperature solution (Fig.3) reduces CO₂ emissions by 5%, despite having a lower thermal efficiency of the storage (~70% vs ~80%).
- Optimal solution was found to be 22°C for $T_{BTES,initial}$ and 4.5°C for the average daily mean temperature trigger $T_{air,set}$. In TRNSYS, the reduction in yearly CO₂ emissions compared to the baseline low-temperature increased to 7.2% (Fig.4).

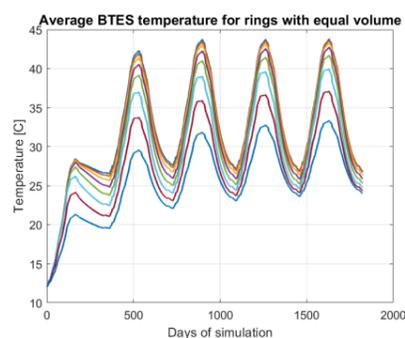


Fig. 3: Temperature evolution of the ground, high-temperature baseline

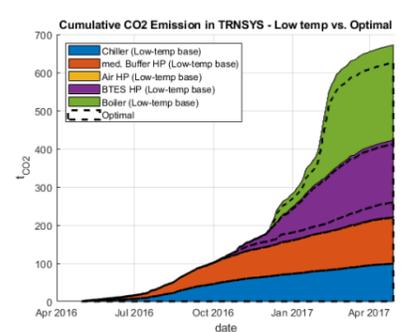


Fig. 4: Comparison of cumulative emissions, baseline low temperature vs Optimal (TRNSYS).

While the optimal solution is better than the two baselines when implemented in the high-fidelity model, the expected emissions by the optimizer is 10% lower than the more realistic one with the same setting. The mismatch is mainly due to the limitations of the different time steps of the models, removal of buffers, and interaction between components, which is simplified in the optimization.

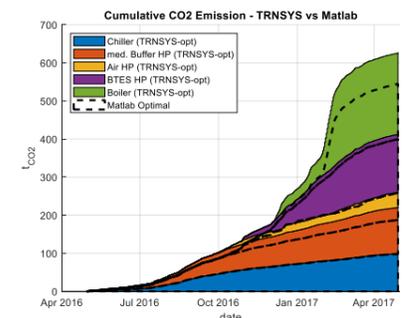


Fig. 5: Comparison of cumulative emissions, Optimal (TRNSYS) vs. Optimal (Matlab).

REFERENCES

- 1 Fiorentini, M., & Baldini, L. (2021). Control-oriented modelling and operational optimization of a borehole thermal energy storage. *Applied Thermal Engineering*, 199, 117518. <https://doi.org/10.1016/j.applthermaleng.2021.117518>
- 2 Weber, R., & Baldini, L. (2018). High Temperature Seasonal BTES for Effective Load Shifting and CO₂ Emission Reduction. *Eurosun 2018 – 12th International Conference on Solar Energy for Buildings and Industry.*, September, 1–9. <https://doi.org/10.18086/eurosun2018.13.04>

CONTACT

Massimo Fiorentini
Empa
Urban Energy Systems Laboratory
Phone: +41 779 60 86 56
massimo.fiorentini@empa.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.

Model development for integrated systems: example application and preliminary results

Work package 3

Edward Lucas¹, Esther Linder¹, Marcel Troxler¹, Philipp Schütz¹, Willy Villasmil¹

¹Lucerne School of Engineering and Architecture, Technikumstrasse 21, 6048 Horw

1 OBJECTIVES

Seldom is thermal energy stored or used to **bridge the seasonal energy gap** in Switzerland, despite the residential sector alone using nearly one third of total energy consumption; with 50 % from oil and gas burning¹. To reduce CO₂ emissions significantly, **flexible integrated energy systems utilizing renewable, sustainable generation and energy storage technologies that enables sector coupling** are required. These systems are crucial to reach the net zero goal by 2050 of the Swiss climate strategy².

To analyse integrated systems of various designs and compositions of generation and storage technologies, it is necessary to have validated models that accurately describe the system and its operational characteristics.

2 CONTRIBUTION TO PATHFNR

Specifically, the contributions are to **provide validated component models of a range of generation and storage technologies**, at various levels of complexity and dynamic detail. In this poster, an application of modelling an integrated system using water-based seasonal energy storage is shown.

To identify viable renewables integration pathways and the potential for energy systems flexibility, this portfolio of validated models is necessary to facilitate conceptual system design, feasibility analysis, as well as eventually operational and techno-economic optimization of such systems. **These models will be used to inform scenario analysis in Work Package 2.**

2 METHODOLOGY

In assembling a suite of models based on an identified set of modelling requirements from WP2, energy generation technologies and storage technologies have both been considered. **Models at various levels of complexity and time-resolution exist and are being developed** – the goal being that analysis is conducted in the most efficient manner; utilizing models at the appropriate level of detail for the degree of insights required (e.g. only using more complex models when dynamic system behaviour is of interest).

It is crucial that models, especially when simplified, nonetheless retain the critical pieces of information necessary to arrive at correct outcomes and insights. An example of this is Thermal Energy Storage (TES) systems that must include operational temperatures within models rather than simply gross energetic content – leading potentially to infeasible flexibility outcomes. **Key performance indicators (KPIs) for each of the technologies are identified**, and agreed upon by experts, allowing subsets of these KPIs to be used as a general method of comparison between conceptualised, existing, and optimized systems³. Figure 1 shows the adopted methodology and how these activities relate.

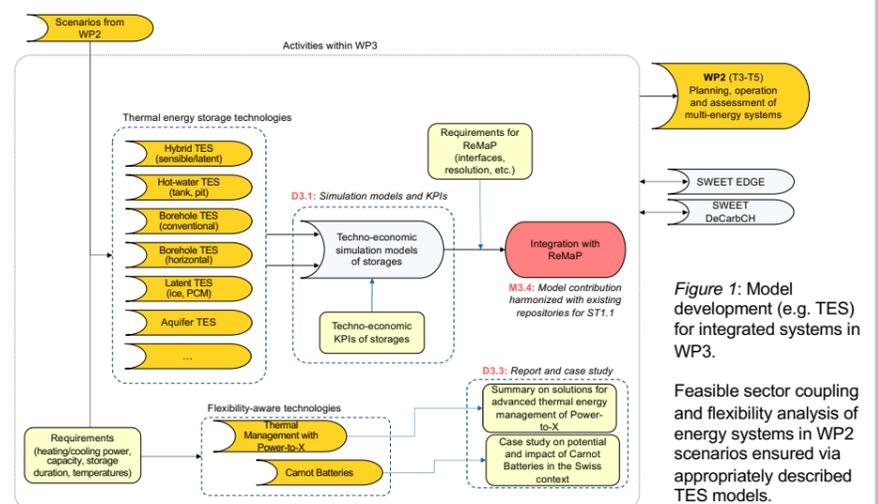


Figure 1: Model development (e.g. TES) for integrated systems in WP3.

Feasible sector coupling and flexibility analysis of energy systems in WP2 scenarios ensured via appropriately described TES models.

3 RESULTS AND NEXT STEPS

Application of simplified energy balance modelling to a planned seasonal thermal energy storage system (Figures 2 and 3), envisioned as a **sustainable and relatively inexpensive solution to bridging the seasonal energy gap** for small to medium sized residences⁴, is readily achieved. Relatively simple steady-state (with the exception of the storage itself) component models are used to **rapidly estimate the suitability and/or feasibility** of implementing such a system under various scenario conditions.

Here, one can explore practical insights in how the system would respond to changes to the physical and economic environmental variables. We see how the temperature levels would plausibly develop and oscillate within the envisioned seasonal storage during the first and subsequent two years of operation. Such modelling allows engineers to extract insights, say, **the amount of heat available from the storage at a particular temperature throughout the year**, as a way of estimating the relative utility of installing such a storage to meet a particular heating demand seen in a test scenario. A relatively easy question could be: would such a system operate in a manner that allows residents to have reliable access to domestic hot water throughout the year? A more complex inquiry could be: **How can such TES systems contribute to the flexibility characteristics of the overall energy system?**

Next steps are to complete validation of the seasonal TES model using existing validated transient models and field data.

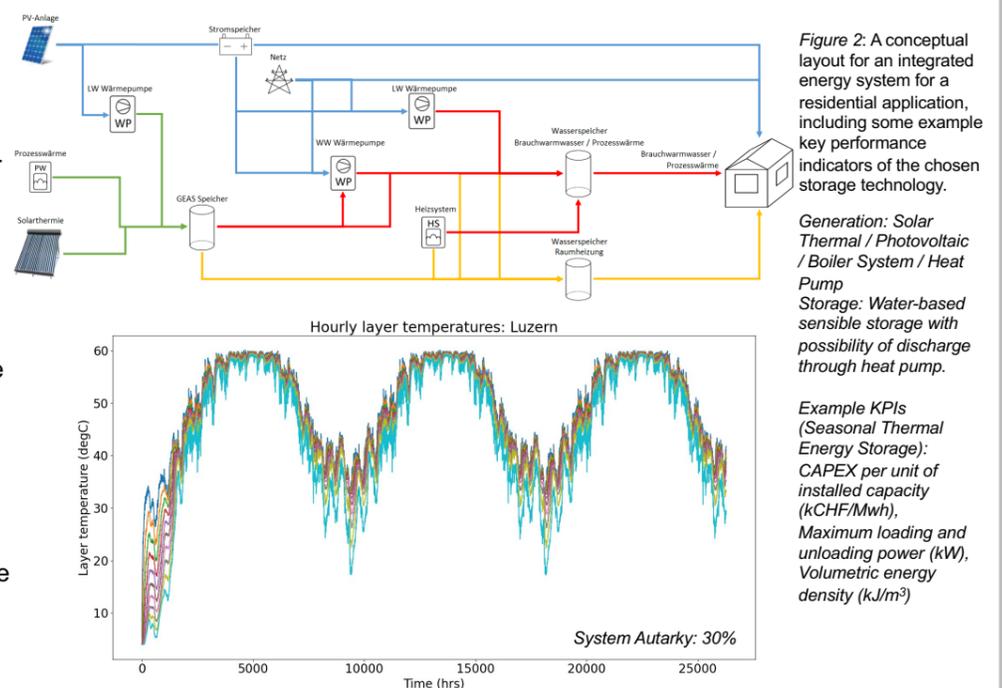


Figure 2: A conceptual layout for an integrated energy system for a residential application, including some example key performance indicators of the chosen storage technology.

Generation: Solar Thermal / Photovoltaic / Boiler System / Heat Pump
Storage: Water-based sensible storage with possibility of discharge through heat pump.

Example KPIs (Seasonal Thermal Energy Storage):
CAPEX per unit of installed capacity (kCHF/Mwh),
Maximum loading and unloading power (kW),
Volumetric energy density (kJ/m³)

REFERENCES

- 1 Overall energy statistics, Federal Office of Energy.
- 2 Long-term climate strategy to 2050, Federal Office for the Environment.
- 3 Evaluation of energy density as performance indicator for thermal energy storage at material and system levels, Joaquim Romani et al. 2019 Applied Energy 235, 954-962
- 4 GEAS Project, Luzern University of Applied Sciences

CONTACT

Edward Lucas
Lucerne School of Engineering and Architecture
CC Thermal Energy Storage
edward.lucas@hslu.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

Estimating heat demands of residential buildings

Work package 2

Esther Linder¹, Marcel Troxler¹, Edward Lucas¹, Philipp Schuetz¹

¹Lucerne School of Engineering and Architecture, Technikumstrasse 21, 6048 Horw

1 OBJECTIVES

In Switzerland, **the residential sector spends nearly a third of the total energy consumption** of which almost 50% is from oil and gas burning¹. To reduce the CO₂ emissions significantly, oil and gas based heating systems need hence to be replaced with renewable options such as heat pumps, especially also to reach the net zero goal by 2050 of the Swiss climate strategy².

To analyse how heat demands can be covered with renewable energy sources and to quantify the flexibility contribution from space heating system, it is necessary to estimate the heat (and cooling) demands for the Swiss building park reliably. This demand depends for example on the geographic location, size, and insulation of the building and its neighbourhood.

2 CONTRIBUTION TO PATHFNDR

To quantify the flexibility between demands and energy sources, a necessary input are demand estimation. These demands concern electricity, but also heat/cooling demands. Through conversion technologies such as a heat pump, the heat demand can be supplied by electricity and hence is a provider of potential sector coupling and flexibilities.

An estimation of **heat demands for residential buildings** is therefore a crucial input to Pathfndr and serves as the **basis for the estimation of the flexibility and sector coupling potential**. In this poster, heat demand estimation for residential buildings are presented.

2 METHODOLOGY

Two approaches to estimate the heat demand of residential buildings are presented. Both of them are based on public building properties such as size or building age (which are taken from the Federal Register of Buildings and Dwellings³(RBD)), assume a constant room temperature of 20°C and take into account weather data. The RBD data has to be used with caution, as it is for some cases incomplete or outdated. However, due to its wide coverage, it is a valid starting point for this analysis. The weather data is taken from Agrometeo⁴, which provides weather data from more than 150 stations in Switzerland with a resolution of 10min. Important for this analysis are the measured ambient temperatures.

One of the approaches uses the **building class to estimate the heat demand based on the SIA norm⁵**. The other one calculates the **heat transmission factor from the building properties directly**, as was also done by Peru Elguezabal *et al* 2019⁶. The heat demand estimation is multiplied, depending on the age of the building and the ambient temperature. In a refined version, the scaling factor is fitted based on clustered real-world consumption.

3 RESULTS AND NEXT STEPS

The distribution of the actual consumption values and the estimated values from the refined method from above is shown in *Figure 1*.

Figure 1 shows the distribution of the specific space heat demands for a city where also the actual heat demands were available. Shown is the number of buildings per specific space heat demand in kWh/m²/a, for the actual measurement as well as the prediction from the model. The three peaks which are present in the measurement at roughly 50, 60, and 80kWh/m²/a are recovered by the modelling. Also, the peak height is satisfyingly similar in the predicted and actual measurement, with an overshoot at the peak around 80kWh/m²/a, which is compensated with a low number of buildings on the right wing of this same peak for the predicted data. A difference occurs with some high consumers at more than 160kWh/m²/a, which are not present in the actual data. Overall, **a satisfying agreement with actual measurement data and the models** was achieved.

The calculation of the heat demand is now **automatized for calculating the yearly heat demand of every building of a complete community**. An example is shown in *Figure 2*, which displays the coordinates of the buildings together with the colour-coded estimated heat demand. We are currently in exchange with different communities to have **more possibility for validation** for the presented approaches.

Next steps are also to **calculate the heat demand on a daily basis**, taking into account the weather data at a specific location.

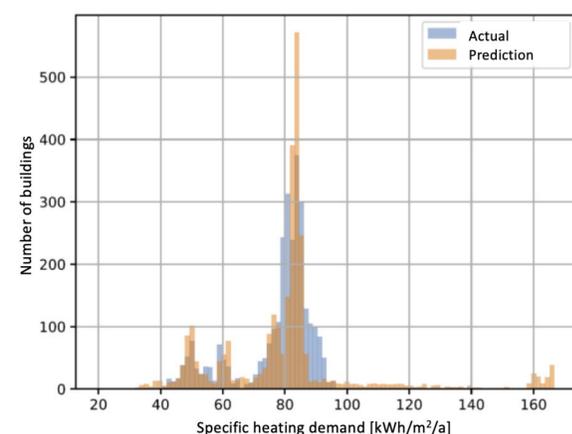


Figure 1: Distribution of heat demands, actual and predicted, for a specific community.

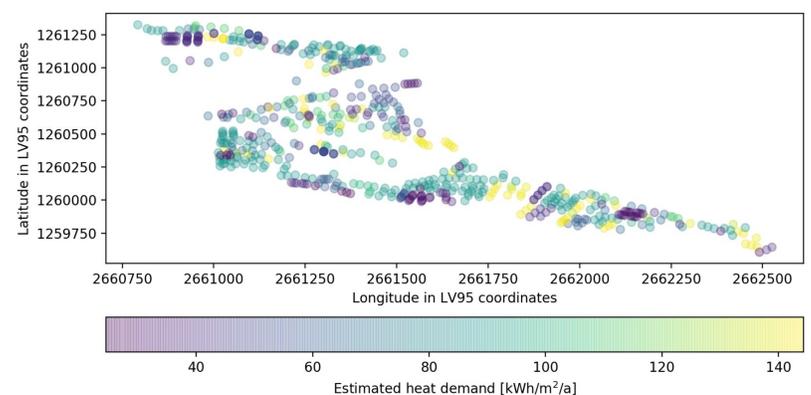


Figure 2: Specific space heat demands calculated for a specific community.

REFERENCES

- 1 Overall energy statistics, Federal Office of Energy.
- 2 Long-term climate strategy to 2050, Federal Office for the Environment.
- 3 Federal Register of Buildings and Dwellings, Federal Statistical Office.
- 4 Agrometeo, Schweizerische Eidgenossenschaft.
- 5 Raumnutzungsdaten für Energie- und Gebäudetechnik, SIA Nr. 2024, Jahr 2021.
- 6 Peru Elguezabal *et al* 2019 *J. Phys.: Conf. Ser.* **1343** 012128.

CONTACT

Esther Linder
Lucerne School of Engineering and
Architecture
CC Thermal Energy Storage
esther.linder@hslu.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.

Flexibility assessment of E-mobility in Multi-energy Systems

Work package 2

Binod Koirala¹, Robin Mutschler¹, Andrea Bartolini³, Andrew Bollinger^{1,2}, Kristina Orehoung¹

¹ Empa Urban energy system Lab

² Sympheny

³ ETH Singapore

1 BACKGROUND AND OBJECTIVES

- Decarbonization of the mobility sector is increasingly becoming important.
- E-mobility emerging as major source of power demand in urban energy system.
- This work studies the flexibility of e-mobility in a multi-energy system.

2 CONTRIBUTION TO PATHFNR

- Enhancement of Ehub tool with e-mobility module.
- Contribution to T3.1 on site planning considering multi-energy flexibility.
- Techno-economic parameters as well as modelling assumptions.

3 METHODOLOGY

- E-hub Tool of Empa is used to perform the planning and operation of multi-energy system.

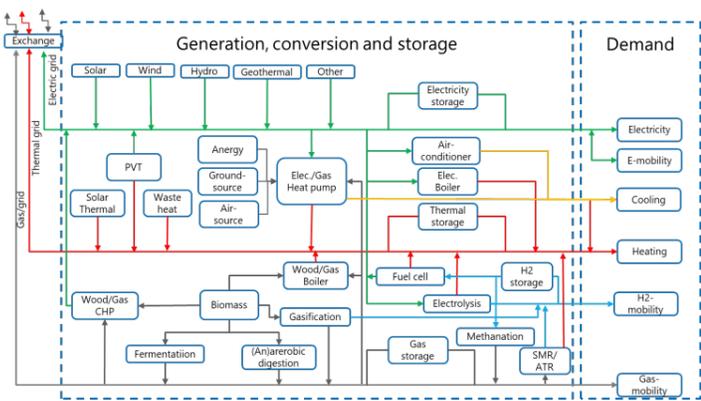


Figure 1: Multi-energy system in Ehub Tool

- An e-mobility module is developed and integrated into the E-hub Tool.

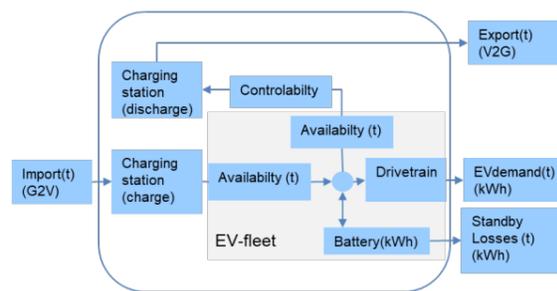


Figure 2: E-mobility module

- The module captures the fleet size, charger size, transport demand, vehicle availability, controllability and battery size.

- The module is tested in the e-hub tool using the multi-energy system in Chur, Switzerland.

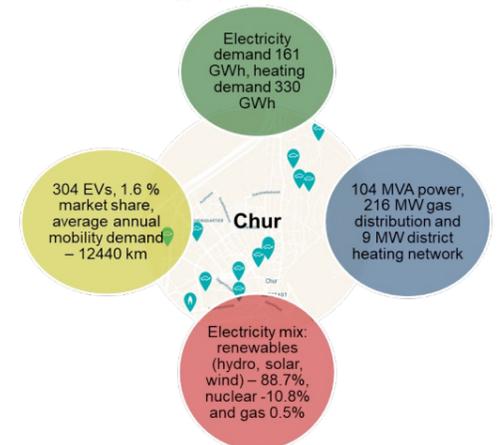


Figure 3: Case study of Chur, Switzerland

3 RESULTS

- E-mobility can provide demand and supply-side flexibility in the multi-energy system, see Fig. 4.
- Under the given boundary conditions and energy-mix, V2G is an attractive solution in a cost optimization over a CO₂ optimization scenario.
- Sensitivity analysis on input parameters as well scenarios will be useful to obtain further insights on the value of e-mobility flexibility.

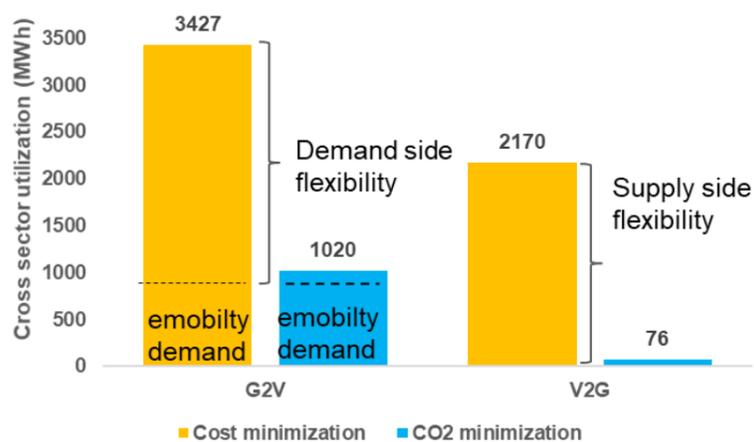


Figure 4: Cross-sector utilization and flexibility between power and e-mobility sector with cost and CO₂ minimization objectives.

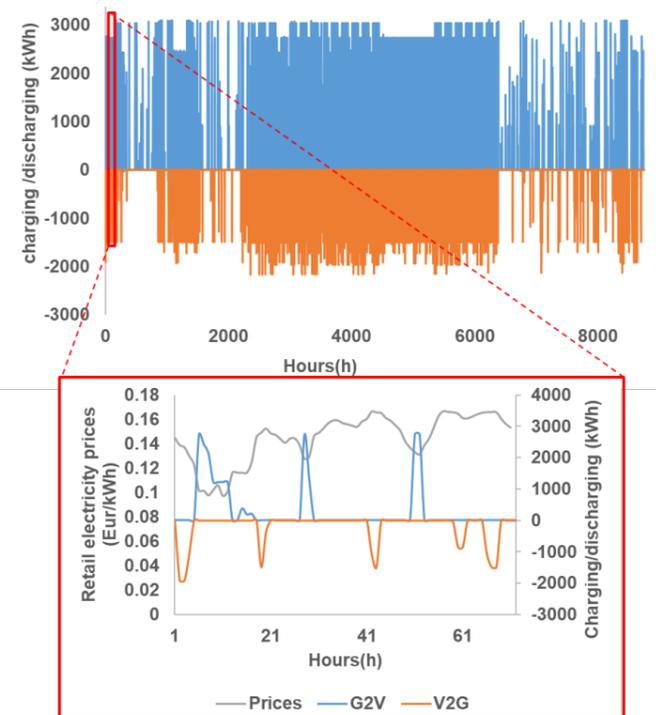


Figure 5: Optimal V2G/G2V profiles of Chur EV fleet with cost minimization and their correlation with electricity prices

REFERENCES

- 1 B. Koirala, R. Mutschler, A. Bartolini, A. Bollinger, and K. Orehoung, "Flexibility assessment of e-mobility in multi-energy districts," CIRED e-mobility workshop, 2-3 June 2022, Porto, doi: [10.1049/icp.2022.0827](https://doi.org/10.1049/icp.2022.0827)
- 2 P. Murray, J. Carmeliet, and K. Orehoung, "Multi-Objective Optimisation of Power-to-Mobility in Decentralised Multi Energy Systems," *Energy*, vol. 205, p. 117792, Aug. 2020, doi: [10.1016/j.energy.2020.117792](https://doi.org/10.1016/j.energy.2020.117792)
- 3 L. A. Bollinger and V. Dorer, "The Ehub Modeling Tool: A flexible software package for district energy system optimization," *Energy Procedia*, vol. 122, pp. 541-546, Sep. 2017, doi: [10.1016/j.egypro.2017.07.402](https://doi.org/10.1016/j.egypro.2017.07.402).

CONTACT

Binod Koirala
Empa
Urban Energy System Lab
Phone: +41
binod.koirala@empa.ch
www.sweet-pathfndr.ch

ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNR consortium.

Modeling and Control of Multi-energy System in a Microgrid

Work package 3


Rahul Gupta, Fernando Soria, Mario Paolone

Distributed Electrical Systems Laboratory, EPFL

1 Objectives

Model predictive control (MPC) of a multi-energy systems in a microgrid – optimization across electrical + gas + thermal grids.

- Objectives
 - Minimize cost of operation (electricity from the grid)
 - Optimize dispatch plan of energy resources
- Constraints
 - Fuel cell system
 - Electrolyzer
 - Battery storage

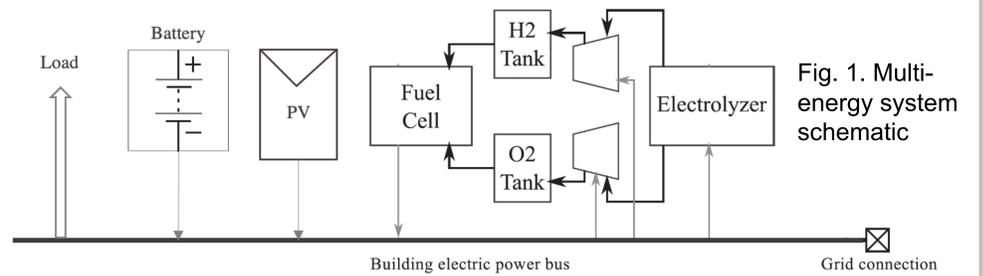

Challenges: Fuel cell (FC) + Electrolyzer (EL) systems are inherently non-linear. It makes the optimization problem **non-convex**.

Assumption: all the resources are connected at the same node, so electrical grid is not modeled (It will be considered in future work).

2 Linearization of FC and EL Models

Voltage dependency with stack temperature and current.

$$v_{FC}(k) = (OCV - (\alpha T_{FC} + \beta)\sqrt{i_{FC}} - (\gamma T_{FC} + \delta)i_{FC})$$

Heat-flow dependency with stack temperature and current.

$$Q_{FC} = ((\alpha T_{FC} + \beta)\sqrt{i_{FC}} + (\gamma T_{FC} + \delta)i_{FC}) i_{FC}$$

First order Taylor's approximation


$$f(x, y) = f(\hat{x}, \hat{y}) + \frac{\partial f}{\partial x(\hat{x}, \hat{y})} (x - \hat{x}) + \frac{\partial f}{\partial y(\hat{x}, \hat{y})} (y - \hat{y})$$

$$\frac{\partial v_{FC}}{\partial T}(\hat{T}, \hat{i}) = \alpha\sqrt{\hat{i}} - \gamma\hat{i}$$

$$\frac{\partial v_{FC}}{\partial i}(\hat{T}, \hat{i}) = \frac{\alpha\hat{T} + \beta}{2\sqrt{\hat{i}}} - (\gamma\hat{T} + \delta)$$

$$\frac{\partial Q_{FC}}{\partial T}(\hat{T}, \hat{i}) = \alpha\hat{i}^{3/2} + \gamma\hat{i}^2$$

$$\frac{\partial Q_{FC}}{\partial i}(\hat{T}, \hat{i}) = (\alpha\hat{T} + \beta)\frac{3}{2}\hat{i}^{1/2} + (\gamma\hat{T} + \delta)2\hat{i}$$

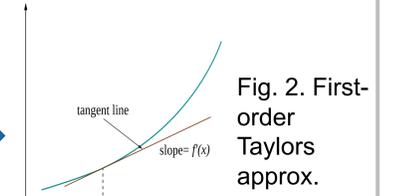

Power from the FC and EL: bilinear terms


$$P_{FC}(k) = v_{FC}(k)i_{FC}(k)$$

$$P_{EL}(k) = v_{EL}(k)i_{EL}(k)$$

Relaxing by McCormick Envelopes – relax the hyperbolic constraints by a bigger polytopic constraints.

$$P \geq \underline{x}y + x\underline{y} - \underline{x}\underline{y} \quad P \leq \bar{x}y + x\bar{y} - \bar{x}\bar{y}$$

$$P \geq \bar{x}y + x\bar{y} - \bar{x}\bar{y} \quad P \leq \underline{x}y + x\underline{y} - \underline{x}\underline{y}$$

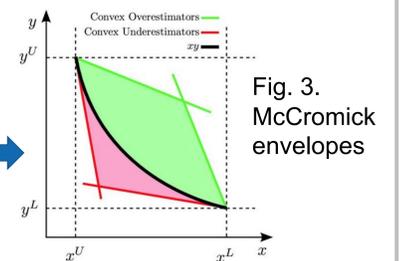

3 Simulation setup


MPC
(Linearized model)
 $k = 1:K$

Fig. 4. Information flow during the simulated experiments

Decision variables:

$$i_{EL,k=1}, i_{FC,k=1}$$

$$P_{BAT,k=1}, Q_{cool,k=1}$$

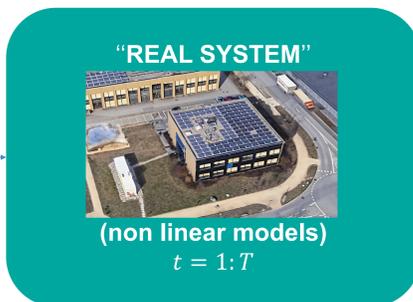

-State variables: $E_{bat}(t), p_{H2}(t), t_{FC}(t)$

-Sensitivity coefficients: $\frac{\partial v_{FC}}{\partial T}(\hat{T}, \hat{i})(t), \dots$

-(Deterministic) forecasts: $P_{PV}(t:t+K-1), Price(t:t+K-1), P_{Load}(t:t+K-1)$

-McCormick envelopes: moving limits

3 Minimize electricity cost

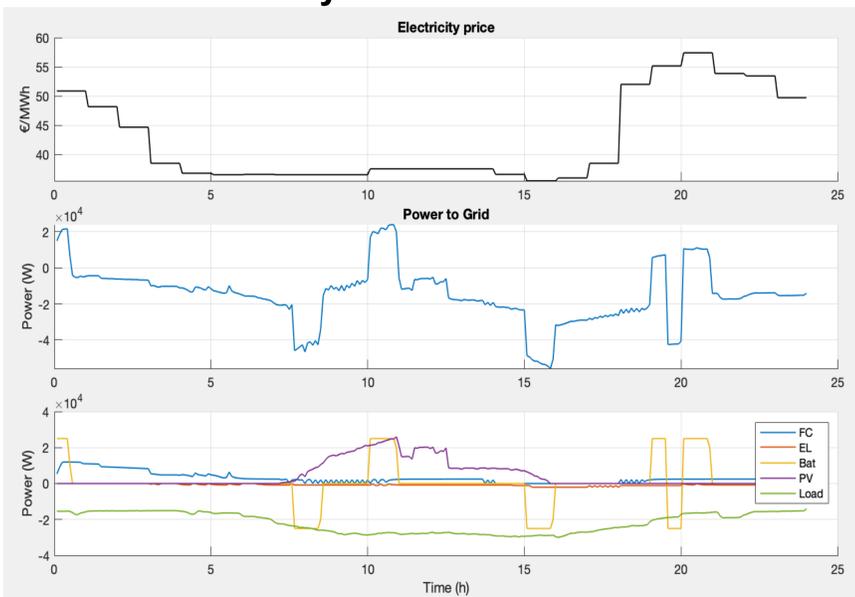


Fig. 4. Optimized power from different resources.

4 Track dispatch plan

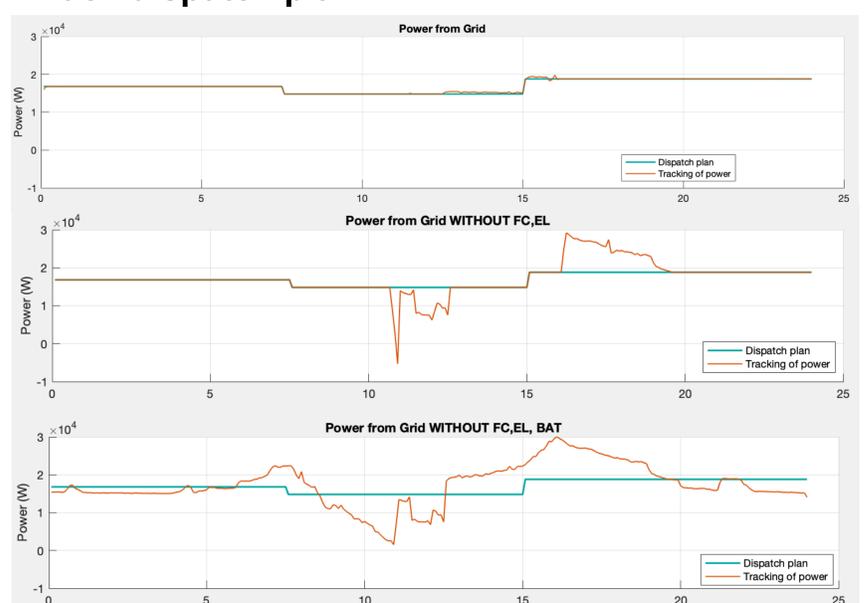


Fig. 5. Dispatch plan tracking by different resources.

5 Cost comparison

	COST (operation)	Dispatch error
With FC, EL	14.25 €	22 kWh
Without FC, EL	16.60 €	365 kWh
Without FC, EL, Battery	17.68 €	1112 kWh

6 Conclusions

- Model predictive control of multi-energy system connected to a microgrid is proposed.
- A linear model of fuel cell and electrolyzer is developed for obtaining tractable control formulation.
- The simulated results show lower costs when fuel cell and electrolyzer are considered in the control.

CONTACT

Rahul Gupta, MSc.
PhD Student, Distributed Electrical Systems Laboratory, EPFL
rahul.gupta@epfl.ch



ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.

Coordinated Multi-grid Dispatch Framework

Work package 3

Rahul Gupta, Mario Paolone

Distributed Electrical Systems Laboratory, EPFL

1 Motivation

- Balancing Groups (BGs) are responsible for coordination between the generation and the demand.
- They are not constrained geographically (in Switzerland).
- Distributed energy resources (DERs) at different sites in distribution systems can be used in aggregated way (**crowd balancing**) to provide **ancillary services** to the transmission network e.g. for *Dispatching, primary frequency regulation etc.*

2.1 Objective

- Flexible resources across different sites are controlled to provide aggregated flexibility to the upper-layer transmission grid.
- By coordinating microgrids at different sites (e.g., EPFL and PSI) to have aggregated response.
- Local constraints of the grid and DERs to be accounted.

2.2 Aggregation Platform

- Objective:** Compute day-ahead dispatch plans of a multi-grid setup.
- Constraints:**
 - Stochasticity of electricity demand and generation (forecasting).
 - Flexibility of the controllable resources.
 - Grid constraints (via a linearized grid model).

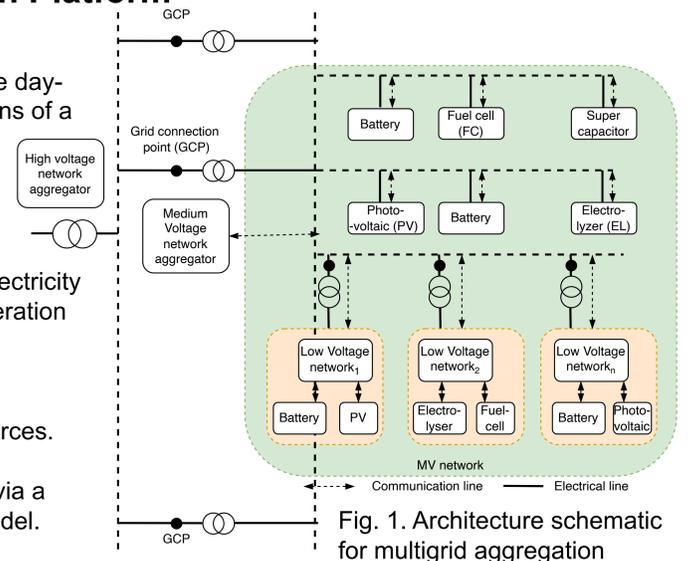


Fig. 1. Architecture schematic for multigrid aggregation

3 Distributed Optimization

- Solved as distributed optimization using Alternating Direction Method of Multipliers (ADMM).
- Allows scalability and decoupling of the models of networks and resources.

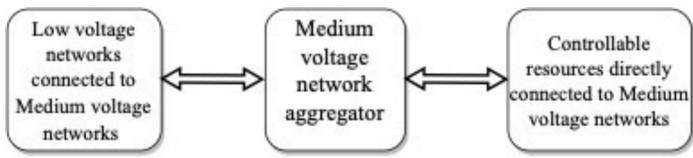


Fig. 2 Information exchange flow-diagram

4 Simulation Setup

- CIGRE MV grid connected to CIGRE LV grids at node N_5 and N_6 .
- CIGRE MV: PV – 1.25 MWp, BESS – 1MWh/0.75MWh.
- CIGRE LV1 and 2 – PV – 100 + 50 kWp, BESS – 750kWh/250kW.



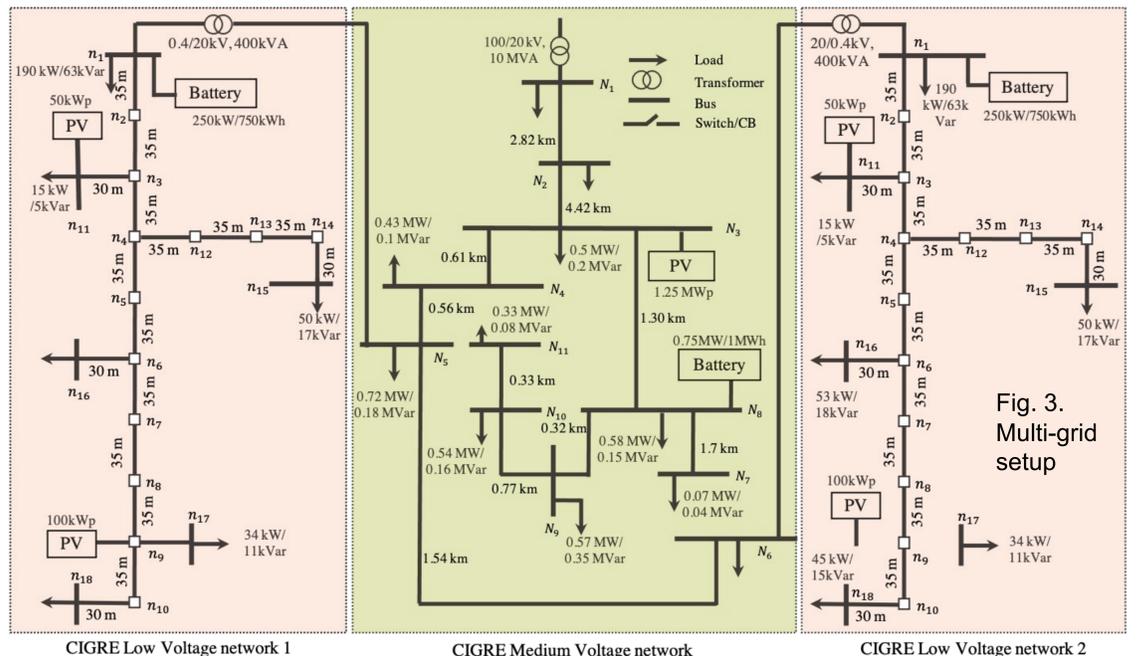


Fig. 3. Multi-grid setup

4 Simulation Results

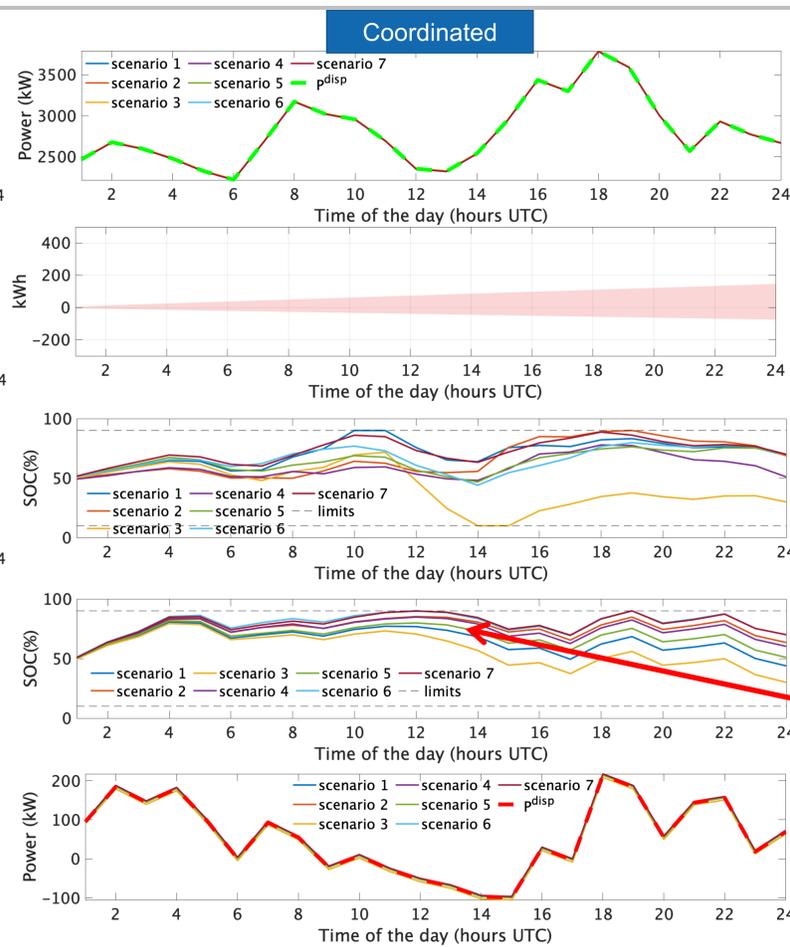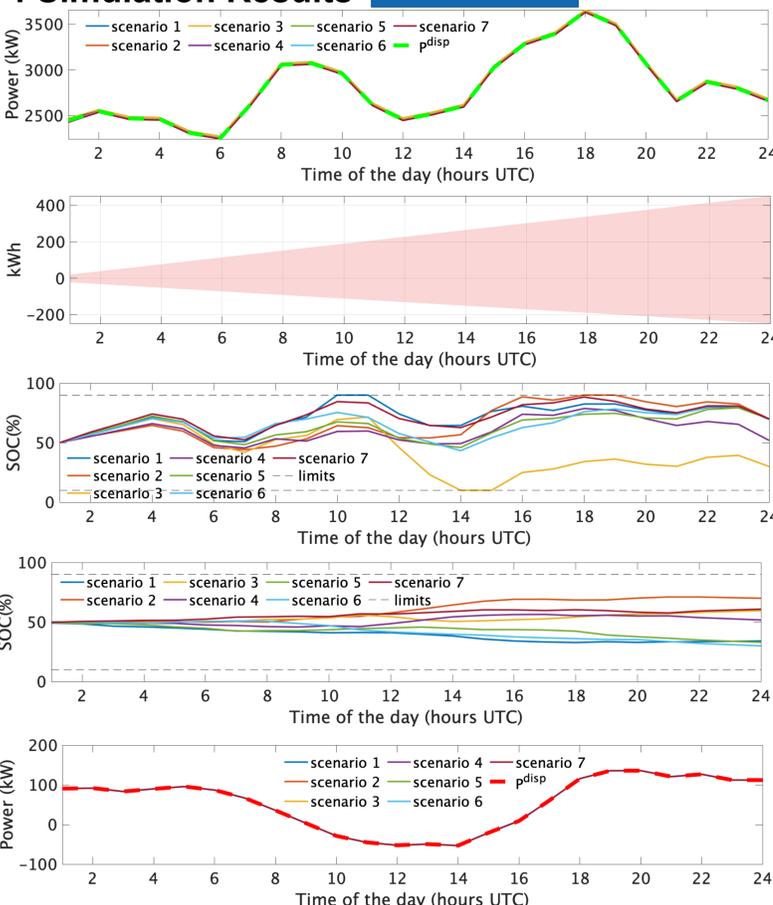

Maximum absolute error (MAE)

$$MAE = \max_{\omega \in \Omega, t \in T} |P_t^{disp} - P_{0,t}^{\omega}|$$

Uncovered energy error (UEE)

$$UEE^+ = \frac{T_s}{3600} \sum_{t \in T} (\max_{\omega \in \Omega} P_{0,t}^{\omega} - P_t^{disp})$$

$$UEE^- = \frac{T_s}{3600} \sum_{t \in T} (\min_{\omega \in \Omega} P_{0,t}^{\omega} - P_t^{disp})$$

Un-coordinated		
MAE (kW)	UEE+ (kWh)	UEE- (kWh)
22	451	-247

Coordinated		
MAE (kW)	UEE+ (kWh)	UEE- (kWh)
6.5	146	-75

LV BESS is providing regulation to the MV grid resulting in BESS saturation as well as change in LV's dispatch plan.

Fig. 4: day-ahead Dispatch computation Without coordination (left) With coordination (right)

For more details, please access the Full paper here:

Conclusions

- A framework is developed for coordinating the flexibilities (power and energy) from different distribution grids while accounting for network constraints.
- The developed framework is applied to day-ahead dispatch computation for a multi-grid system.
- It shows better dispatch performance (tracking) when flexibility and uncertainties of the downstream distribution systems are considered in computing the dispatch plan.

Rahul Gupta, MSc.
PhD Student, Distributed Electrical Systems Laboratory EPFL,
rahul.gupta@epfl.ch



ACKNOWLEDGMENTS

This work was sponsored by the Swiss Federal Office of Energy's "SWEET" programme and performed in the PATHFNDR consortium.

Network tariffs for flexible loads (NETFLEX*)

Authors: Patrick Ludwig and Christian Winzer (winc@zhaw.ch)

Abstract

Dynamic grid tariffs can incentivize grid-serving behavior of load without requiring direct load control by grid operators. However, they need to be designed appropriately to avoid rebound peaks and welfare losses due to unnecessary demand response activations. We analyze the performance of 9 different dynamic tariff designs with regard to their impact on household consumption behavior and grid utilization. In a linear optimization model, we determine the optimal operation of electric vehicles, heat pumps, batteries and PV systems based on four result metrics: (i) Effectiveness (ii) Efficiency, (iii) Profitability of technologies & (iv) equity. We find that in a system with a large share of flexible devices, direct load control and capacity prices effectively reduce load peaks. Time variable grid tariffs create problematic new rebound peaks, however, this could be avoided, by a novel approach where the tariff is charged proportional to the grid-load, rather than as a function of time.

Inputs

We model 9 different tariff scenarios for 300 households in 2 different years.

Infrastructure in 2020 is based on the current penetration of new technologies according to the Swiss Household Energy Demand Survey (SHEDS).

Infrastructure in 2050 is based on the "Energy perspectives" Szenario ZERO Basis.

Tariff scenarios

SQ: Energy, Grid and other tariffs: constant price per kWh (=Basecase)

Capacity Grid: Capacity charge on individual peak

DLC: Grid: Direct Load Control

ToU: Grid: High-/Low Tariff

CPP_h: Critical-Peak Price (dynamic hours)

CPP_d: Grid: Critical-Peak Price (fixed hours; dynamic days)

Gridload: Grid: Proportional to grid-load

Gridload&spot: Energy: Spot-pricing & Grid: Proportional to grid-load

Spot: Energy: Spot-pricing


Infrastructure Scenarios

HH-Type	Household Features				Household Count		Simulation	
	HP	EV	Battery	PV	2020	2050	2020	2050
type1	0	0	0	0	211	66	70.3%	22.0%
type2	1	0	0	0	57	0	19.0%	0.0%
type3	0	1	0	0	5	29	1.7%	9.7%
type4	0	0	0	1	4	0	1.3%	0.0%
type5	1	1	0	0	3	4	1.0%	1.3%
type6	1	0	0	1	3	0	1.0%	0.0%
type7	0	1	0	1	0	1	0.0%	0.3%
type8	0	0	1	1	8	0	2.7%	0.0%
type9	1	1	0	1	1	60	0.3%	20.0%
type10	1	0	1	1	6	0	2.0%	0.0%
type11	0	1	1	1	1	0	0.3%	0.0%
type12	1	1	1	1	1	140	0.3%	46.7%
Total					300	300	100%	100%

Simulation

The simulation model consists of three steps:

- 1 Calculate system costs based on infrastructure scenario and calibrate tariffs to ensure cost recovery
- 2 Optimize dispatch of flexible loads to minimize consumer bill for the given tariff, while avoiding discomfort
- 3 Recalibrate tariff levels to ensure cost recovery

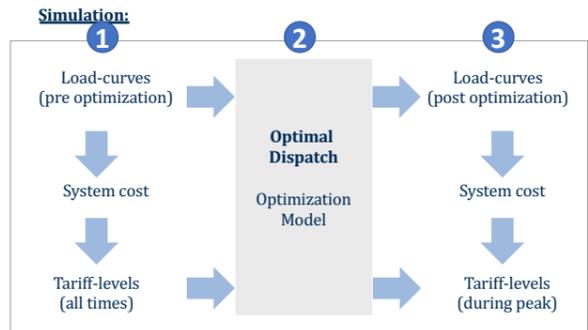

Results for 2020

Tariff impact on peak-load of the grid

- 1 Capacity tariff avoids rebound peak, but hardly lowers original peak
- 2 DLC achieves strongest peak reduction without rebound
- 3 Time-dependent tariffs lead to rebound peak
- 4 Gridload reduces peak without rebound; inclusion of spot price weakens effectiveness

Tariff impact on average system cost

- Cost impacts small, as only 30% of grid cost, and 0% of base-cost are variable, and peak is reduced by less than 20% (DLC)
- DLC achieves strongest grid-cost reduction, but ignores energy costs

Tariff impact on average annual cost of households with different technologies

- 1 Most tariffs increase profitability of flexible loads
- 2 ...while increasing cost of unflexible customers
- 3 Tariffs proportional to grid-load and DLC reduce the cost for (almost) all household types

Tariff impact on average annual cost of households from different income brackets

- A capacity tariff, gridload tariff and Direct Load Control (DLC) reduce the average cost for households in all income brackets
- DLC achieves strongest grid-cost reduction, but ignores energy costs

Disclaimer

*) The project has received funding from SFOE. Authors alone are responsible for the findings and conclusions.